



Digital Controller
High-speed AT type **HA400/HA900** Instruction Manual
Standard AT type **HA401/HA901**

IMR01N01-E9 All Rights Reserved. Copyright © 2002, RKC INSTRUMENT INC.
Thank you for purchasing this RKC product. In order to achieve maximum performance and ensure proper operation of the instrument, carefully read all the instructions in this manual. Please place the manual in a convenient location for easy reference.

For detailed handling procedures and key operations, refer to separate **HA400/HA900/HA401/HA901 Operation Manual (IMR01N02-E□)**.
The manual can be downloaded from the official RKC website:
http://www.rkcinst.com/english/manual_load.htm.

WARNING

- To prevent injury to persons, damage to the instrument and the equipment, a suitable external protection device shall be required.
- All wiring must be completed before power is turned on to prevent electric shock, fire or damage to the instrument and the equipment.
- This instrument must be used in accordance with the specifications to prevent fire or damage to the instrument and the equipment.
- This instrument is not intended for use in locations subject to flammable or explosive gases.
- Do not touch high-voltage connections such as power supply terminals, etc. to avoid electric shock.
- RKC is not responsible if this instrument is repaired, modified or disassembled by other than factory-approved personnel. Malfunction may occur and warranty is void under these conditions.

CAUTION

- This product is intended for use with industrial machines, test and measuring equipment. (It is not designed for use with medical equipment and nuclear energy plant.)
- This is a Class A instrument. In a domestic environment, this instrument may cause radio interference, in which case the user may be required to take additional measures.
- This instrument is protected from electric shock by reinforced insulation. Provide reinforced insulation between the wire for the input signal and the wires for instrument power supply, source of power and loads.
- Be sure to provide an appropriate surge control circuit respectively for the following:
 - If input/output or signal lines within the building are longer than 30 meters.
 - If input/output or signal lines leave the building, regardless the length.
- This instrument is designed for installation in an enclosed instrumentation panel. All high-voltage connections such as power supply terminals must be enclosed in the instrumentation panel to avoid electric shock to operating personnel.
- All precautions described in this manual should be taken to avoid damage to the instrument or equipment.
- If the equipment is used in a manner not specified by the manufacturer, the protection provided by the equipment may be impaired.
- All wiring must be in accordance with local codes and regulations.
- All wiring must be completed before power is turned on to prevent electric shock, instrument failure, or incorrect action. The power must be turned off before repairing work for input break and output failure including replacement of sensor, contactor or SSR, and all wiring must be completed before power is turned on again.
- To prevent instrument damage as a result of failure, protect the power line and the input/output lines from high currents with a suitable overcurrent protection device with adequate breaking capacity such as a fuse, circuit breaker, etc.
- A malfunction in this product may occasionally make control operations impossible or prevent alarm outputs, resulting in a possible hazard. Take appropriate measures in the end use to prevent hazards in the event of malfunction.
- Prevent metal fragments or lead wire scraps from falling inside instrument case to avoid electric shock, fire or malfunction.
- Tighten each terminal screw to the specified torque found in the manual to avoid electric shock, fire or malfunction.
- For proper operation of this instrument, provide adequate ventilation for heat dissipation.
- Do not connect wires to unused terminals as this will interfere with proper operation of the instrument.
- Turn off the power supply before cleaning the instrument.
- Do not use a volatile solvent such as paint thinner to clean the instrument. Deformation or discoloration may occur. Use a soft, dry cloth to remove stains from the instrument.
- To avoid damage to the instrument display, do not rub with an abrasive material or push the front panel with a hard object.

NOTICE

- This manual assumes that the reader has a fundamental knowledge of the principles of electricity, process control, computer technology and communications.
- The figures, diagrams and numeric values used in this manual are only for explanation purpose.
- RKC is not responsible for any damage or injury that is caused as a result of using this instrument, instrument failure or indirect damage.
- RKC is not responsible for any damage and/or injury resulting from the use of instruments made by imitating this instrument.
- Periodic maintenance is required for safe and proper operation of this instrument. Some components have a limited service life, or characteristics that change over time.
- Every effort has been made to ensure accuracy of all information contained herein. RKC makes no warranty, expressed or implied, with respect to the accuracy of the information. The information in this manual is subject to change without prior notice.
- No portion of this document may be reprinted, modified, copied, transmitted, digitized, stored, processed or retrieved through any mechanical, electronic, optical or other means without prior written approval from RKC.

Product Check

Mounting brackets: 2 (Waterproof/Dustproof type: 4)
Instruction Manual: 1 (IMR01N01-E9)

1. MOUNTING


WARNING

To prevent electric shock or instrument failure, always turn off the power before mounting or removing the instrument.

■ Mounting Cautions

- This instrument is intended to be used under the following environmental conditions. (IEC 61010-1) [OVERVOLTAGE CATEGORY II, POLLUTION DEGREE 2]
 - Use this instrument within the following environment conditions:
 - Allowable ambient temperature: -10 to +50 °C (14 to 122 °F)
 - Allowable ambient humidity: 5 to 95%RH (Absolute humidity: MAX. W. C 29 g/m³ dry air at 101.3 kPa)
 - Installation environment conditions: Indoor use, Altitude up to 2000 m
- Avoid the following conditions when selecting the mounting location:
 - Rapid changes in ambient temperature which may cause condensation.
 - Excessive dust, salt or iron particles.
 - Corrosive or inflammable gases.
 - Excessive induction noise, static electricity, magnetic fields or noise.
 - Direct vibration or shock to the mainframe.
 - Direct air flow from an air conditioner.
 - Water, oil, chemicals, vapor or steam splashes.
 - Exposure to direct sunlight.
 - Excessive heat accumulation.
- Mount this instrument in the panel considering the following conditions:
 - Provide adequate ventilation space so that heat does not build up.
 - Do not mount this instrument directly above the equipment that generates large amount of heat (heaters, transformers, semi-conductor functional devices, large-wattage resistors.)
 - If the ambient temperature rises above 50 °C (122 °F), cool this instrument with a forced air fan, cooler, etc. Cooled air should not blow directly on this instrument.
- In order to improve safety and the immunity to withstand noise, mount this instrument as far away as possible from high voltage equipment, power lines, and rotating machinery.
 - High voltage equipment: Do not mount within the same panel.
 - Power lines: Separate at least 200 mm.
 - Rotating machinery: Separate as far as possible.
- For correct functioning mount this instrument in a horizontal position.
- In case this instrument is connected to a supply by means of a permanent connection, a switch or circuit-breaker shall be included in the installation. This shall be in close proximity to the equipment and within easy reach of the operator. It shall be marked as the disconnecting device for the equipment.

■ Dimensions

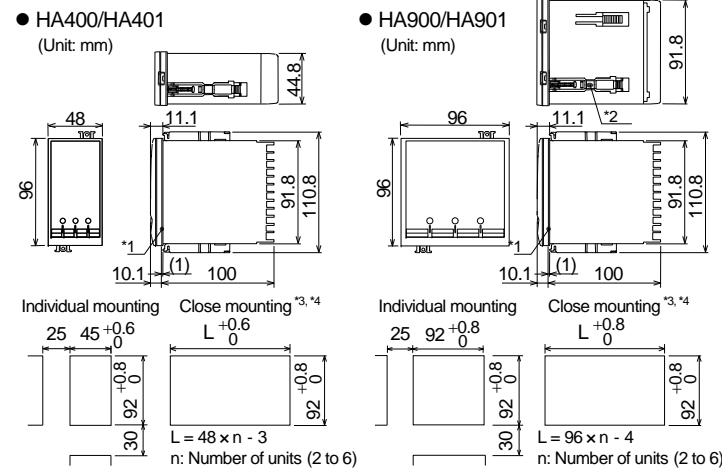

*1 Rubber gasket (optional) *2 Up to 4 mounting brackets may be used.
*3 If the HA400/HA401s or HA900/HA901s have waterproof/dustproof (optional), protection will be compromised and not meet IP65 by close mounting.
*4 When controllers are closely mounted, ambient temperature must not exceed 50 °C (122 °F).
For mounting of the HA400/HA401 or HA900/HA901, panel thickness must be between 1 to 10 mm. When mounting multiple HA400/HA401s or HA900/HA901s close together, the panel strength should be checked to ensure proper support.





■ Mounting Procedures

- Prepare the panel cutout as specified in ■ Dimensions.
- Insert the instrument through the panel cutout.
- Insert the mounting bracket into the mounting groove of the instrument. Do not push the mounting bracket forward. (Fig. 1)
- Secure the bracket to the instrument by tightening the screw. Take care to refrain from moving the bracket forward.
- Only turn about one full revolution after the screw touches the panel. (Fig. 2)
If the screw has been rotated too tight, the screw may turn idle. In such a case, loosen the screw once and tighten it again until the instrument is firmly fixed.
- The other mounting bracket should be installed in the same way as described in 3 to 5.

- When the instrument is mounted, always secure with two mounting brackets so that upper and lower mounting brackets are positioned diagonally.
- The waterproof/dustproof (optional) on the front of the instrument conforms to IP65 when mounted on the panel. Checked and confirmed its compliance through the internal test at RKC. For effective waterproof/dustproof, the gasket must be securely placed between the instrument and the panel without any gap. If the gasket is damaged, please contact RKC sales office or the agent.

■ Removal Procedures

- Turn the power OFF.
- Remove the wiring.
- Loosen the screw of the mounting bracket.
- Hold the mounting bracket by the edge (1) and tilt it (2) to remove from the case. (Fig. 3)
- The other mounting bracket should be removed in the same way as described in 3 and 4.
- Pull out the instrument from the mounting cutout while holding the front panel frame of this instrument. (Fig. 4)



2. WIRING


WARNING

To prevent electric shock or instrument failure, do not turn on the power until all wiring is completed. Make sure that the wiring is correct before applying power to the instrument.


■ Wiring Cautions

- For thermocouple input, use the appropriate compensation wire.
- For RTD input, use low resistance lead wire with no difference in resistance between the three or four lead wires.
- Signal connected to Voltage input and Current input shall be low voltage defined as "SELV" circuit per IEC 60950-1.
- To avoid noise induction, keep input signal wire away from instrument power line, load lines and power lines of other electric equipment.
- If there is electrical noise in the vicinity of the instrument that could affect operation, use a noise filter.
 - Shorten the distance between the twisted power supply wire pitches to achieve the most effective noise reduction.
 - Always install the noise filter on a grounded panel. Minimize the wiring distance between the noise filter output and the instrument power supply terminals to achieve the most effective noise reduction.
 - Do not connect fuses or switches to the noise filter output wiring as this will reduce the effectiveness of the noise filter.
- Allow approximately 5 seconds for contact output when the instrument is turned on. Use a delay relay when the output line is used for an external interlock circuit.


- Power supply wiring must be twisted and have a low voltage drop.
- This instrument is not provided with an overcurrent protection device. For safety install an overcurrent protection device (such as a fuse) with adequate breaking capacity close to the instrument.
 - Fuse type: Time-lag fuse (Approved fuse according IEC 60127-2 and/or UL 248-14)
 - Fuse rating: Rated current: 1.0 A
- For an instrument with 24 V power supply input, supply power from a "SELV" circuit defined as IEC 60950-1.
- A suitable power supply should be considered in end-use equipment. The power supply must be in compliance with a limited-energy circuits (maximum available current of 8 A).
 - Screw size: M3 x 6 (With 5.8 x 8 square washer)
 - Recommended tightening torque: 0.4 N·m (4 kgf·cm)
 - Specified dimension: Refer to Fig. at the right
 - Specified solderless terminals: With isolation
 - Applicable wire: Solid/twisted wire of 0.25 to 1.65 mm²
- Make sure that during field wiring parts of conductors cannot come into contact with adjacent conductive parts.



■ Terminal Configuration (All the terminal configuration of HA400, HA401, HA900 and HA901 is the same.)

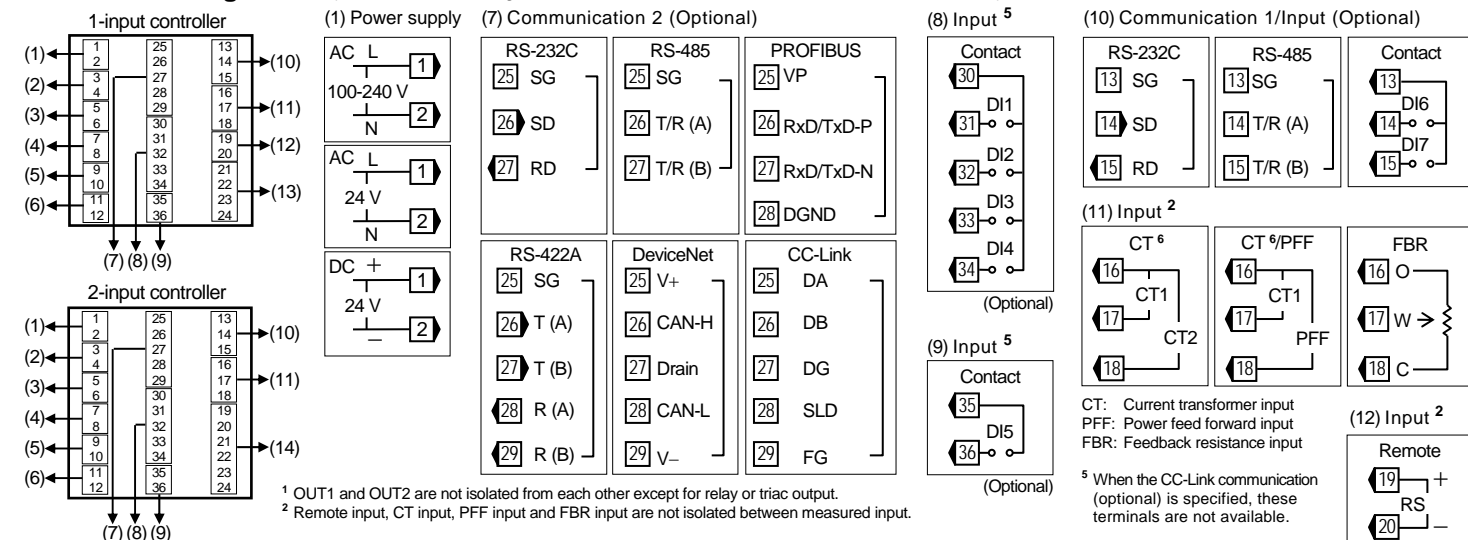


¹ OUT1 and OUT2 are not isolated from each other except for relay or triac output.
² Remote input, CT input, PFF input and FBR input are not isolated between measured input.

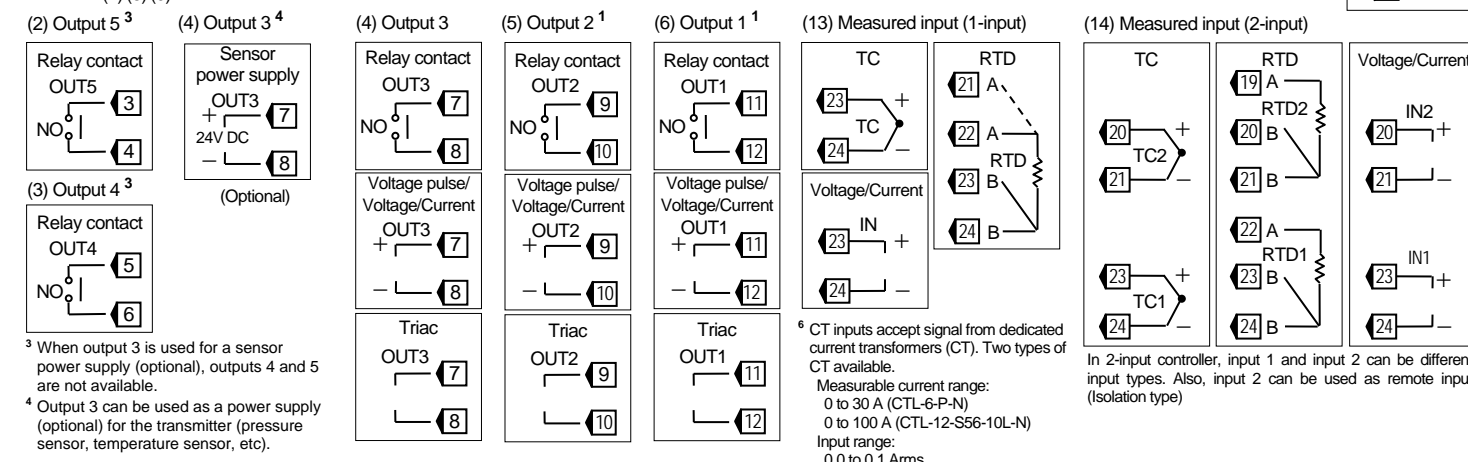

■ Specifications

Power supply voltage:	90 to 264 V AC [Including power supply voltage variation] (Rating: 100 to 240 V AC), 50/60 Hz 21.6 to 26.4 V AC [Including power supply voltage variation] (Rating: 24 V AC), 50/60 Hz 21.6 to 26.4 V DC [Including power supply voltage variation] (Rating: 24 V DC)	Voltage output:	0 to 5 V DC, 1 to 5 V DC, 0 to 10 V DC (Allowable load resistance 1 kΩ or more)
Power consumption:	HA400/HA401: 16.5 VA max. (at 100 V AC) 22.5 VA max. (at 240 V AC) 15.0 VA max. (at 24 V AC) 430 mA max. (at 24 V DC) HA900/HA901: 17.5 VA max. (at 100 V AC) 24.0 VA max. (at 240 V AC) 16.0 VA max. (at 24 V AC) 470 mA max. (at 24 V DC)	Triac output:	Allowable load current: 0.4 A Minimum load current: 30 mA Load voltage: 75 to 250 V AC
Measured input:	TC input, RTD input, Voltage input, Current input	Sensor power supply output (Optional) [Only OUT3 is selectable]:	Rated voltage: 24 V DC ± 5% Rated current: 24 mA max.
Optional input:	Remote input (Not isolation type), Feedback resistance input, CT input, Event input, Power feed forward input	Output 4 and Output 5:	Relay contact output: 250 V AC, 1 A (Resistive load), 1a contact Electrical life: 300,000 times or more (Rated load)
Output 1 to Output 3:	Relay contact output: 250 V AC, 3 A (Resistive load), 1a contact Electrical life: 300,000 times or more (Rated load) 0/12 V DC (Allowable load resistance 600 Ω or more)	Control method:	Brilliant PID control (Direct action, Reverse action, Position proportioning or Cascade is available)
Voltage pulse output:	0 to 20 mA DC, 4 to 20 mA DC (Allowable load resistance 600 Ω or less)	Allowable ambient temperature:	-10 to +50 °C (14 to 122 °F)
Current output:	0 to 20 mA DC, 4 to 20 mA DC (Allowable load resistance 600 Ω or less)	Allowable ambient humidity:	5 to 95%RH Absolute humidity: 29 g/m ³ dry air at 101.3 kPa
		Operating environment:	There should be neither corrosive gases nor much dust.
		Weight:	HA400/HA401: Approx. 360 g HA900/HA901: Approx. 460 g

3. PARTS DESCRIPTION

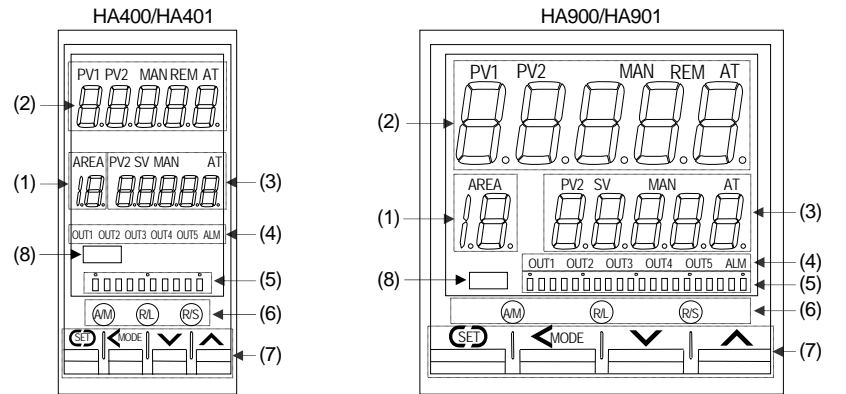

(1) Area display	Area (AREA) lamp [Green]	Lights when memory area number is displayed.
Memory area display		Displays memory area number (1 to 16).
(2) Upper display	Measured value 1 (PV1) lamp [Green]	Lights when measured value 1 is displayed on the PV1/PV2 display unit.
Measured value 2 (PV2) lamp *	[Green]	Lights when measured value 2 is displayed on the PV1/PV2 display unit.
Manual (MAN) mode lamp [Green]		Lights when operated in manual mode.
Remote (REM) mode lamp [Green]		Lights when remote setting function is activated.
Autotuning (AT) lamp [Green]		Flashes when autotuning is activated. (After autotuning is completed: AT lamp will go out)
Measured value (PV1/PV2) display		Displays PV1, PV2 or various parameters' symbols.

* This lamp is activated only with 2-input controller.

(3) Lower display	Measured value 2 (PV2) lamp *	[Green]	Lights when measured value 2 is displayed on the SV display unit.
Set value (SV) lamp [Green]		Lights when set value (SV) is displayed on the SV display unit.	
Manual (MAN) mode lamp *	[Green]	Lights when operated in manual mode.	
Autotuning (AT) lamp *	[Green]	Flashes when autotuning is activated. (After autotuning is completed: AT lamp will go out)	
Set value (SV) display		Displays SV, PV2 or various parameters' set values.	

* This lamp is activated only with 2-input controller.

(4) Output/Alarm lamp	Output (OUT1 to OUT5) lamp [Green]	Lights when the output corresponding to each lamp is ON.
Alarm (ALM) lamp [Red]		Lights when alarm (Event or HBA function) is turned on. The type of alarm which is on can be checked on the event monitor display.

(5) Bar graph display *
One of the displays shown in the table below can be selected for the bar-graph.

Manipulated output value (MV) display	Displays the manipulated output value (MV). When manipulated output value (MV) is at 0 % or less, the left-end dot of the bar-graph flashes. When MV exceeds 100 %, the right-end dot at the right end flashes.
Feedback resistance input value (POS) display	Displays the feedback resistance input value (POS). (Available with position proportioning PID control)
Deviation display	Displays the deviation between the measured value (PV) and the set value (SV). When the Deviation display is selected, the dots at both ends of bar-graph light.
Measured value display	Displays the measured value (PV). Scaling is available within the input range.
Set value display	Displays the set value (SV). Scaling is available within the input range.

*The number of dots: 10 dots (HA400/401), 20 dots (HA900/901)

(6) Direct key	Auto/Manual transfer key (AM)	Switching the Auto/Manual control mode between Auto (PID control) mode and Manual mode.
Remote/Local transfer key (RL)		Switching the Remote/Local control mode between Remote control and Local control.
RUN/STOP transfer key (RS)		Switching the RUN/STOP mode between RUN and STOP.

(7) Operation key	Set (SET) key	Used for calling up parameters and set value registration.
Shift key (MODE)		Shifts digits when settings are changed. Used to selection operation between modes.
Down key		Decreases numerals.
Up key		Increases numerals.

(8) Infrared port
Used when sending and receiving data between this controller and the PDA installed with the RKCir software.

To avoid damage to the instrument, never use a sharp object to press keys.

4. OPERATION FLOW OF EACH MODE

In order to make this instrument operable after being mounted on equipment and then wired, it needs to be set with operating conditions such as the set value (SV), input/output function, control function, etc. specific to each customer. In addition, the following operational flowchart illustrates key operation in each mode or each setting item. When actually setting these operating conditions specific to the customer, refer to the HA400/HA900/HA401/HA901 Operation Manual (IMR01N02-E□).

