

Module Type Controller SRX

Temperature Control Module for PLC Communication

X-TIO-R

Instruction Manual

IMS01N12-E2

Thank you for purchasing this RKC product. In order to achieve maximum performance and ensure proper operation of your new instrument, carefully read all the instructions in this manual. Please place the manual in a convenient location for easy reference.

SYMBOLS

WARNING : This mark indicates precautions that must be taken if there is danger of electric shock, fire, etc., which could result in loss of life or injury.

CAUTION : This mark indicates that if these precautions and operating procedures are not taken, damage to the instrument may result.



: This mark indicates that all precautions should be taken for safe usage.



: This mark indicates important information on installation, handling and operating procedures.



: This mark indicates supplemental information on installation, handling and operating procedures.



: This mark indicates where additional information may be located.



WARNING

- To prevent injury to persons, damage to instrument and equipment, a suitable external protection device shall be required.
- All wiring must be completed before power is turned on to prevent electric shock, fire or damage to instrument and equipment.
- This instrument must be used in accordance with the specifications to prevent fire or damage to instrument and equipment.
- This instrument is not intended for use in locations subject to flammable or explosive gases.
- Do not touch high-voltage connections such as power supply terminals, etc. to avoid electric shock.
- RKC is not responsible if this instrument is repaired, modified or disassembled by other than factory-approved personnel. Malfunction can occur and warranty is void under these conditions.

CAUTION

- This product is intended for use with industrial machines, test and measuring equipment. (It is not designed for use with medical equipment and nuclear energy.)
- This is a Class A instrument. In a domestic environment, this instrument may cause radio interference, in which case the user may be required to take additional measures.
- This instrument is protected from electric shock by reinforced insulation. Provide reinforced insulation between the wire for the input signal and the wires for instrument power supply, source of power and loads.

- Be sure to provide an appropriate surge control circuit respectively for the following:
 - If input/output or signal lines within the building are longer than 30 meters.
 - If input/output or signal lines leave the building, regardless the length.
- This instrument is designed for installation in an enclosed instrumentation panel. All high-voltage connections such as power supply terminals must be enclosed in the instrumentation panel to avoid electric shock by operating personnel.
- All precautions described in this manual should be taken to avoid damage to the instrument or equipment.
- All wiring must be in accordance with local codes and regulations.
- All wiring must be completed before power is turned on to prevent electric shock, instrument failure, or incorrect action. The power must be turned off before repairing work for input break and output failure including replacement of sensor, contactor or SSR, and all wiring must be completed before power is turned on again.
- To prevent instrument damage as a result of failure, protect the power line and the input/output lines from high currents with a suitable overcurrent protection device with adequate breaking capacity such as fuse, circuit breaker, etc.
- Prevent metal fragments or lead wire scraps from falling inside instrument case to avoid electric shock, fire or malfunction.
- Tighten each terminal screw to the specified torque found in the manual to avoid electric shock, fire or malfunction.
- For proper operation of this instrument, provide adequate ventilation for heat dispensation.
- Do not connect wires to unused terminals as this will interfere with proper operation of the instrument.
- Turn off the power supply before cleaning the instrument.
- Do not use a volatile solvent such as paint thinner to clean the instrument. Deformation or discoloration will occur. Use a soft, dry cloth to remove stains from the instrument.
- To avoid damage to instrument display, do not rub with an abrasive material or push front panel with a hard object.
- Do not connect modular connectors to telephone line.
- When high alarm with hold action/re-hold action is used for Event function, alarm does not turn on while hold action is in operation. Take measures to prevent overheating which may occur if the control device fails.

NOTICE

- This manual assumes that the reader has a fundamental knowledge of the principles of electricity, process control, computer technology and communications.
- The figures, diagrams and numeric values used in this manual are only for purpose of illustration.
- RKC is not responsible for any damage or injury that is caused as a result of using this instrument, instrument failure or indirect damage.
- RKC is not responsible for any damage and/or injury resulting from the use of instruments made by imitating this instrument.
- Periodic maintenance is required for safe and proper operation of this instrument. Some components have a limited service life, or characteristics that change over time.
- Every effort has been made to ensure accuracy of all information contained herein. RKC makes no warranty expressed or implied, with respect to the accuracy of the information. The information in this manual is subject to change without prior notice.
- No portion of this document may be reprinted, modified, copied, transmitted, digitized, stored, processed or retrieved through any mechanical, electronic, optical or other means without prior written approval from RKC.

1. OUTLINE

One X-TIO-R module enables temperature control corresponding to two channels. It has power supply and communication terminals in addition to temperature control input and output terminals. In addition, it has modular connectors for PLC communication/host communication.

[Communication type of modular connector]

Any of following communication types can be selected.

- PLC communication and host communication: Each 1 port
- Host communication: 2 ports


[Communication port assignment]

Three communication ports (COM. PORT1 to 3) of the X-TIO-R module can be selected from among the following four assignments.

	Assignment 1	Assignment 2	Assignment 3	Assignment 4
COM. PORT1	Host communication 1	PLC communication	Host communication 1	Host communication 2
COM. PORT2/ COM. PORT3	PLC communication	Host communication 1	Host communication 2	Host communication 1



For host communication 1 or 2, its data bit configuration, communication speed and communication protocol can be independently set.

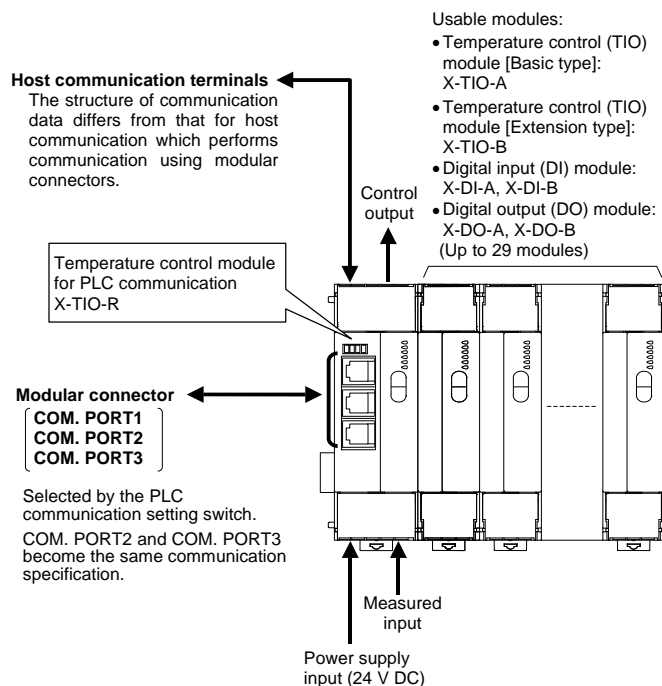

For communication port assignments, refer to the **4.2 Protocol Selections and Communication Speed Setting (P. 5)**.




All data are set by communication. For details, refer to the **Module Type Controller SRX PLC/Host Communication Instruction Manual (IMS01N13-E□)**.



For host communication using host communication terminals, refer to the **Module Type Controller SRX Communication Instruction Manual (IMS01N01-E□)**.


■ System configuration example

● Host communication 1/PLC communication

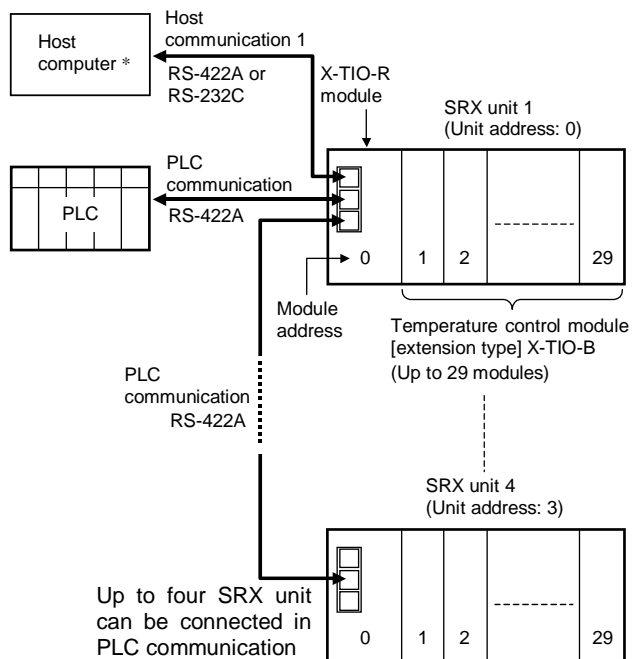

* The host computer connected to COM. PORT1 can communicate only with SRX unit 1.

● Host communication 1/Host communication 2

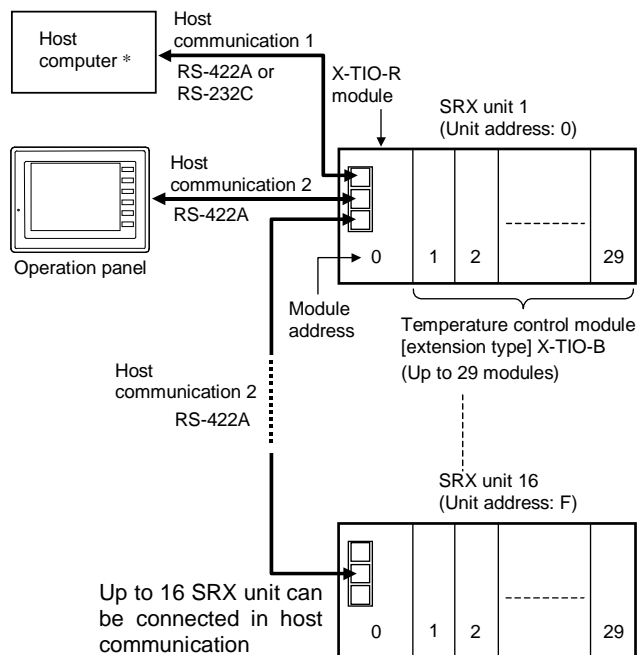

* The host computer connected to the COM. PORT1 can communicate only with the SRX unit 1.



For multi-drop connection with the COM. PORT1 side, refer to the **Module Type Controller SRX PLC/Host Communication Instruction Manual (IMS01N13-E□)**.

2. PRODUCT CHECK

Before using this product, check each of the following:

- Model code
- Check that all of the accessories delivered are complete.
- Check that there are no scratch or breakage in external appearance (case, front panel, or terminal, etc).

X-TIO-R- □ □ - □ □ * □ □ - □ / Y
 (1) (2) (3) (4) (5) (6) (7) (8) (9)

(1) Type

R: Module for PLC communication

(2) Input channel 1, (3) Input channel 2

K: Thermocouple K	D: RTD Pt100
J: Thermocouple J	P: RTD JPt100
T: Thermocouple T	1: 0 to 10 mV DC
S: Thermocouple S	2: 0 to 100 mV DC
R: Thermocouple R	3: 0 to 1 V DC
A: Thermocouple PL II	4: 0 to 5 V DC
N: Thermocouple N	5: 0 to 10 V DC
E: Thermocouple E	6: 1 to 5 V DC
W: Thermocouple W5Re/W26Re	7: 0 to 20 mA DC
B: Thermocouple B	8: 4 to 20 mA DC

(4) Control output 1, (5) Control output 2

M: Relay contact output
V: Voltage pulse output 0/12 V DC
4: 0 to 5 V DC
5: 0 to 10 V DC
6: 1 to 5 V DC
7: 0 to 20 mA DC
8: 4 to 20 mA DC

(6) CT1 input, (7) CT2 input

N: None
P: CTL-6-P-N
S: CTL-12-S56-10L-N

(8) Communication function (COM. PORT1) *

1: RS-232C
4: RS-422A

* Host communication terminals is RS-485 (Fixed),
 COM. PORT2/COM. PORT3 is RS-422A (Fixed).

(9) Version symbol

No code: For Japanese domestic market
 /Y: For International market



Heater break alarm (HBA) function cannot be used when control output is Voltage/Current output.



■ Accessories

End Plate	2
Joint connector cover.....	2
X-TIO-R Instruction Manual (IMS01N12-E2).....	1



If any of the products are missing, damaged, or if your manual is incomplete, please contact RKC sales office or the agent.

3. PARTS DESCRIPTION

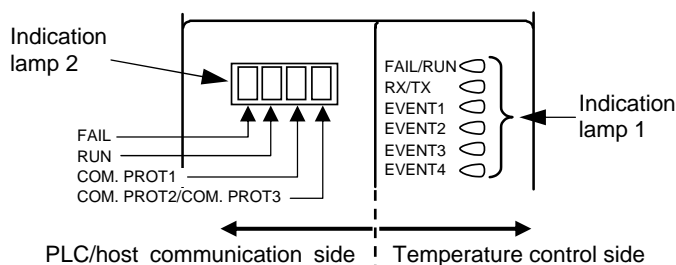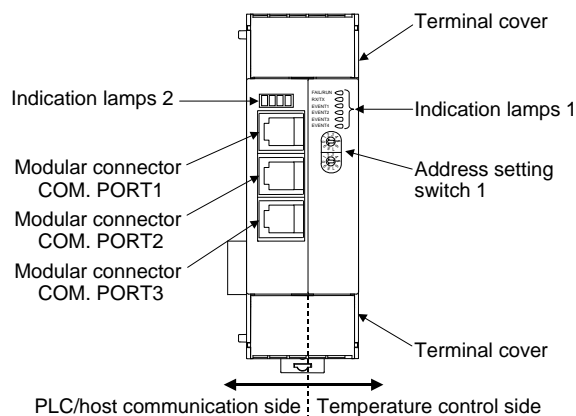

[Indication lamps 1]

- **FAIL/RUN** (for temperature control)
 When normally: A green lamp turns on (RUN)
 When abnormally: A red lamp turns on (FAIL)
 During self-diagnostic error: A green lamp flashes
- **RX/TX** (for internal communication)
 During data send and receive: A green lamp turns on
- **EVENT 1 to 4**
 Display various states by setting.
 Display contents:
 Event 1 state, Event 2 state, Comprehensive event state,
 Output state, Control state, Execution segment state, Time
 signal state

[Indication lamps 2]

- **FAIL** (for PLC/host communication)
 When normally: A red lamp turns off
 When abnormally: A red lamp turns on
 Communication environment setting mode by the switch:
 A red lamp flashes
- **RUN** (for PLC/host communication)
 When normally: A green lamp turns on
 When abnormally: A green lamp turns off
 Memory backup error: A green lamp flashes slowly
 Module configuration error: A green lamp flashes slowly
 PLC communication error: A green lamp flashes slowly
 Data collection just after the power is turned on:
 A green lamp flashes rapidly
- **COM. PORT1**
 During data send and receive: A yellow lamp turns on
- **COM. PORT2/COM. PORT3**
 During data send and receive: A yellow lamp turns on

4. COMMUNICATION SETTING

Set communication setting before mounting and wiring of SRX.

CAUTION

Do not separate the module mainframe from the terminal base with the power turned on. If so, instrument failure may result.

■ Setting at using PLC communication


- Address setting switch 1 (front) [Refer to P. 4]
Set an address of module.
- Address setting switch 2 (left side) [Refer to P. 4]
Set the unit address for PLC communication.
- PLC communication setting switch (left side) [Refer to P. 5]
Set the communication speed, data bit configuration, and protocol for PLC communication. Set the same value as communication settings of PLC.
In addition, select the communication port of modular connector.
- Host communication setting switch 1 (right side) [Refer to P. 6]
Set the communication speed, data bit configuration, and protocol for host communication using host communication terminals. Set the same value as communication settings of host computer.

■ Setting at using host communication 1

- Address setting switch 1 (front) [Refer to P. 4]
Set an address of module.
- Address setting switch 2 (left side) [Refer to P. 4]
Set the unit address for host communication 1.
- PLC communication setting switch (left side) [Refer to P. 5]
Select the communication port of modular connector.
- Host communication setting switch 2 (left side) [Refer to P. 5]
Set the communication speed, data bit configuration, and protocol for host communication 1. Set the same value as communication settings of host computer.
- Host communication setting switch 1 (right side) [Refer to P. 6]
Set the communication speed, data bit configuration, and protocol for host communication using host communication terminals. Set the same value as communication settings of host computer.

■ Setting at using host communication 2

- Address setting switch 1 (front) [Refer to P. 4]
Set an address of module.
- Address setting switch 2 (left side) [Refer to P. 4]
Set the unit address for host communication 2.
- PLC communication setting switch (left side) [Refer to P. 5]
Set the communication speed, data bit configuration, and protocol for host communication 2. Set the same value as communication settings of host computer.
In addition, select the communication port of modular connector.
- Host communication setting switch 1 (right side) [Refer to P. 6]
Set the communication speed, data bit configuration, and protocol for host communication using host communication terminals. Set the same value as communication settings of host computer.

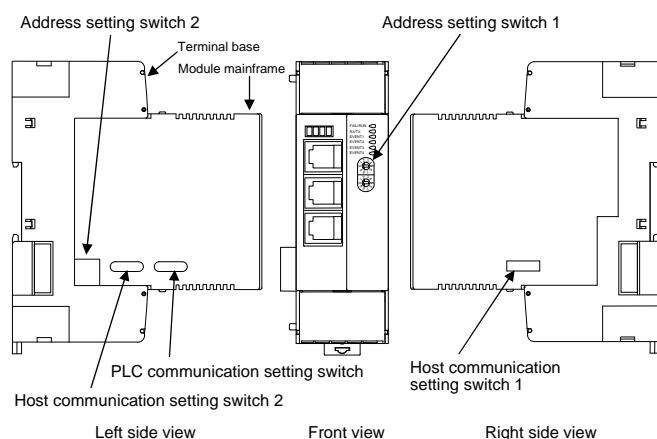

4.1 Address Setting

Set an address. For this setting, use a small slotted screwdriver.




To avoid problems or malfunction, do not duplicate an address on the same communication line.

■ Module address setting

When using two or more modules, set the desired address to each module.

(Common to PLC communication and host communication)

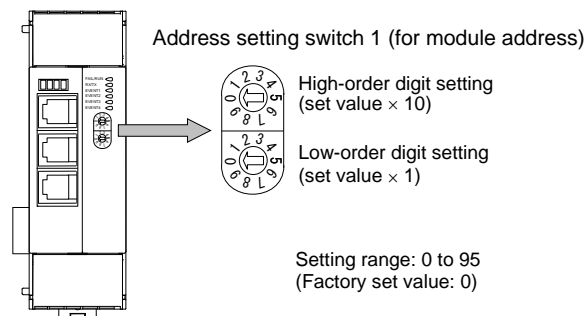


- Do not set address 96 to 99. Otherwise, malfunction may result.
- For Modbus, the value obtained by adding "1" to the set address corresponds to the address used for the actual program.
- Set the module address such that it is different to the other addresses on the same line. Otherwise, problems or malfunction may result.

■ Unit address setting

When two or more X-TIO-R modules are multi-drop connected, set an address to each X-TIO-R module. This becomes the unit address of the SRX unit.

(Common to PLC communication/host communication)

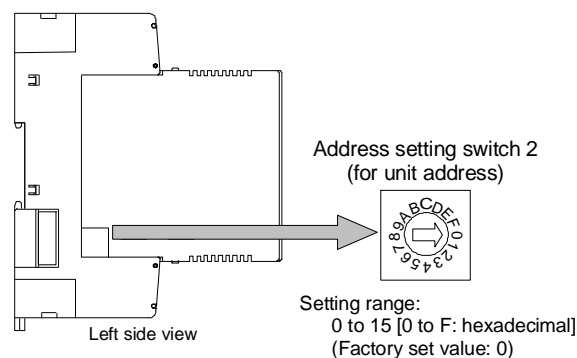

● PLC communication

Up to four X-TIO-R modules can be connected to a PLC communication port. Therefore the unit address uses the four X-TIO-R modules as a group. Use consecutive numbers in any one of four groups in the following table as unit address.

Group	Address setting switch 2	Group	Address setting switch 2
Group 1	0	Group 3	8
	1		9
	2		A
	3		B
Group 2	4	Group 4	C
	5		D
	6		E
	7		F



Always set the unit address of each group including 0, 4, 8 or C. 0, 4, 8 or C becomes the master for communication transfer.

● Host communication

Differently from PLC communication, there are no group restrictions. Free settings can be made in the range of 0 to F.




For Modbus, the value obtained by adding "1" to the set address corresponds to the address used for the actual program.

4.2 Protocol Selections and Communication Speed Setting

■ PLC communication setting switch

Set the communication speed, data bit configuration, and protocol for PLC communication and host communication 2. In addition, select the communication port of modular connector. The data changes become valid when the power is turned on again or when changed to RUN/STOP.

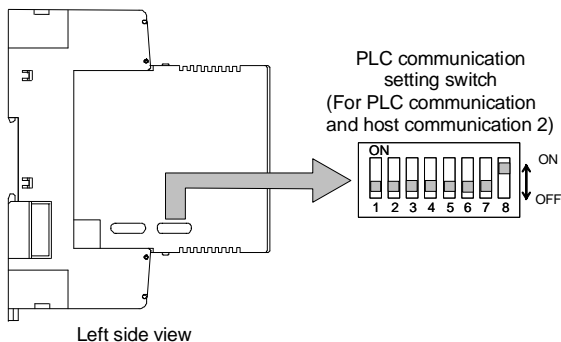

1	2	Data bit configuration
OFF	OFF	Data 8-bit, without parity, Stop 1-bit
ON	OFF	Data 7-bit *, Odd parity, Stop 1-bit
OFF	ON	Data 7-bit *, Even parity, Stop 1-bit
ON	ON	Data 7-bit *, Even parity, Stop 2-bit

* To be changed to data 8-bit only when "Host communication 2 (Modbus)" is selected.

Factory set value: Data 8-bit, without parity, Stop 1-bit

3	4	Communication speed
OFF	OFF	9600 bps
ON	OFF	19200 bps
OFF	ON	38400 bps
ON	ON	Do not set this one

Factory set value: 9600 bps

5	6	7	Communication protocol
OFF	OFF	OFF	Host communication 2 (RKC communication)
ON	OFF	OFF	Host communication 2 (Modbus)
OFF	ON	OFF	Do not set this one
ON	ON	OFF	
OFF	OFF	ON	PLC communication MITSUBISHI MELSEC series special protocol ACPU common command (WR/WW)
ON	OFF	ON	PLC communication MITSUBISHI MELSEC series special protocol AnA/AnUCPU common command (QR/QW)
OFF	ON	ON	Do not set this one
ON	ON	ON	

Factory set value: Host communication 2 (RKC communication)

8	Communication port assignment
OFF	COM. PORT1: PLC communication/host communication 2 [RS-232C/RS-422A] COM. PORT2/COM. PORT3: Host communication 1 [RS-422A]
ON	COM. PORT1: Host communication 1 [RS-232C/RS-422A] COM. PORT2/COM. PORT3: PLC communication/host communication 2 [RS-422A]

Factory set value: COM. PORT1:

Host communication 1 [RS-232C/RS-422A]

COM. PORT2/COM. PORT3:

PLC communication/host communication 2 [RS-422A]




When two or more X-TIO-R modules are multi-drop connected, set the PLC communication setting switches in all of the X-TIO-R modules to the same positions.



COM. PORT2 and COM. PORT3 become the same communication specification.

■ Host communication setting switch 2

Set the communication speed, data bit configuration, protocol and termination resistor of internal data bus for host communication 1.

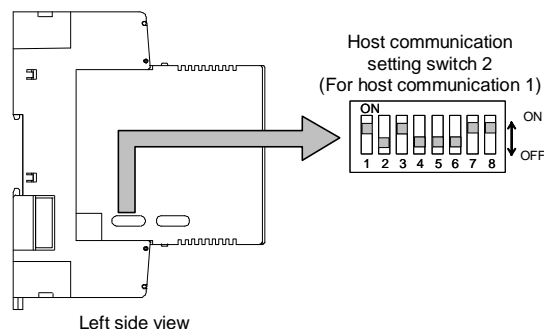

1	2	Communication speed
OFF	OFF	2400 bps
ON	OFF	9600 bps
OFF	ON	19200 bps
ON	ON	38400 bps

Factory set value: 9600 bps

3	4	5	Data bit configuration
OFF	OFF	OFF	Data 7-bit, without parity, Stop 1-bit *
OFF	OFF	ON	Data 7-bit, Even parity, Stop 1-bit *
OFF	ON	ON	Data 7-bit, Odd parity, Stop 1-bit *
ON	OFF	OFF	Data 8-bit, without parity, Stop 1-bit
ON	OFF	ON	Data 8-bit, Even parity, Stop 1-bit
ON	ON	ON	Data 8-bit, Odd parity, Stop 1-bit

* When the Modbus communication protocol is selected, this setting becomes invalid.

Factory set value: Data 8-bit, without parity, Stop 1-bit

6	Communication protocol
OFF	Host communication 1 (RKC communication)
ON	Host communication 1 (Modbus)

Factory set value: Host communication 1 (RKC communication)

8	Internal data bus termination resistor setting
OFF	Termination resistor OFF
ON	Termination resistor ON


Factory set value: Termination resistor ON



- Switch No. 7 must be always ON. Do not set to OFF.
- When connecting two or more modules (TIO module [Extension type] etc.) to the X-TIO-R module, match all of their communication speed, data bit configuration and communication protocol settings with the settings of the X-TIO-R module.

■ Host communication setting switch 1

Set the communication speed, data bit configuration, protocol, and termination resistor of internal data bus for host communication using host communication terminals.

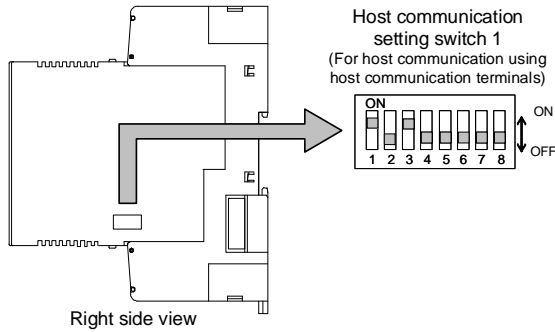

1	2	Communication speed
OFF	OFF	2400 bps
ON	OFF	9600 bps
OFF	ON	19200 bps
ON	ON	38400 bps

Factory set value: 9600 bps

3	4	5	Data bit configuration
OFF	OFF	OFF	Data 7-bit, without parity, Stop 1-bit *
OFF	OFF	ON	Data 7-bit, Even parity, Stop 1-bit *
OFF	ON	ON	Data 7-bit, Odd parity, Stop 1-bit *
ON	OFF	OFF	Data 8-bit, without parity, Stop 1-bit
ON	OFF	ON	Data 8-bit, Even parity, Stop 1-bit
ON	ON	ON	Data 8-bit, Odd parity, Stop 1-bit

* When the Modbus communication is protocol selected, this setting becomes invalid.

Factory set value: Data 8-bit, without parity, Stop 1-bit

6	Protocol selection
OFF	RKC communication
ON	Modbus


Factory set value: RKC communication

8	Internal data bus termination resistor setting
OFF	Termination resistor OFF
ON	Termination resistor ON

Factory set value: Termination resistor OFF



- Switch No. 7 must be always OFF. Do not set to ON.
- When connecting two or more modules (TIO module [Extension type] etc.) to the X-TIO-R module, match all of their communication speed, data bit configuration and communication protocol settings with the settings of the X-TIO-R module.
- Internal data bus termination resistor setting
When two or more other modules are connected to one X-TIO-R module:

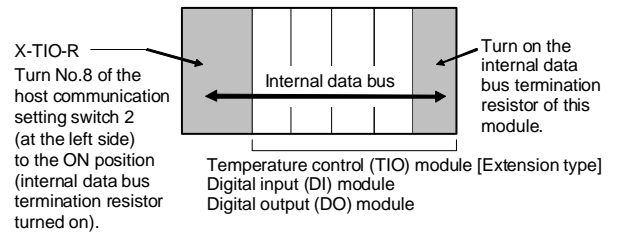

When connected the X-TIO-R module alone:

Host communication setting switch 1:

Turn No.8 to the ON position (internal data bus termination resistor turned on).

Host communication setting switch 2:

Turn No.8 to the ON position (internal data bus termination resistor turned on).

- Be changed into communication time setting mode by using switch No. 4, 5 and 6.



For communication time setting mode, refer to the **Module Type Controller SRX PLC/Host Communication Instruction Manual (IMS01N13-E□)**.

5. MOUNTING




WARNING

To prevent electric shock or instrument failure, always turn off the power before mounting or removing the instrument.

5.1 Mounting Cautions

- (1) This instrument is intended to be used under the following environmental conditions. **(IEC61010-1)**
[OVERVOLTAGE CATEGORY II, POLLUTION DEGREE 2]
- (2) Use this instrument within the following environment conditions.
 - Allowable ambient temperature: -10 to +50 °C
 - Allowable ambient humidity: 5 to 95 %RH
(Absolute humidity: MAX. W. C 29.3 g/m³ dry air at 101.3 kPa)
 - Installation environment conditions: Indoor use
Altitude up to 2000 m
- (3) Avoid the following when selecting the mounting location:
 - Rapid changes in ambient temperature, which may cause condensation.
 - Corrosive or inflammable gases.
 - Direct vibration or shock to the mainframe.
 - Water, oil, chemicals, vapor or steam splashes.
 - Excessive dust, salt or iron particles.
 - Excessive induction noise, static electricity, magnetic fields or noise.
 - Direct air flow from an air conditioner.
 - Exposure to direct sunlight.
 - Excessive heat accumulation.
- (4) Mount this instrument in the panel considering the following conditions:
 - Provide adequate ventilation space so that heat does not build up.
 - Do not mount this instrument directly above equipment that generates large amount of heat (heaters, transformers, semi-conductor functional devices, large-wattage resistors.)
 - If the ambient temperature rises above 50 °C, cool this instrument with a forced air fan, cooler, etc. Cooled air should not blow directly on this instrument.
 - In order to improve safety and the immunity to withstand noise, mount this instrument as far away as possible from high voltage equipment, power lines, and rotating machinery.
 - High voltage equipment: Do not mount within the same panel.
 - Power lines: Separate at least 200 mm.
 - Rotating machinery: Separate as far as possible.
 - Ensure at least 50 mm space on top and bottom of the control unit for maintenance and environmental reasons.
- (5) In case this instrument is connected to a supply by means of a permanent connection, a switch or circuit-breaker shall be included in the installation. This shall be in close proximity to the equipment and within easy reach of the operator. It shall be marked as the disconnecting device for the equipment.


5.2 Dimensions

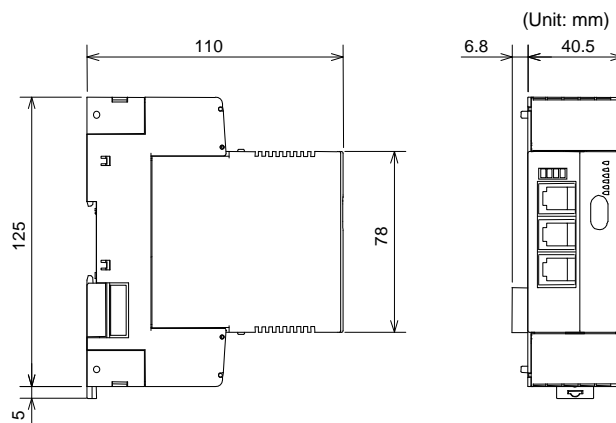


5.3 DIN rail Mounting

■ Mounting procedures

1. Pull down the mounting bracket at the bottom of the module (A). Attach the hooks on the top of the module to the DIN rail and push the lower section into place on the DIN rail (B).

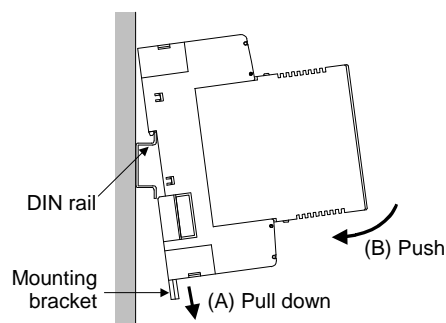


2. Slide the mounting bracket up to secure the module to the DIN rail.

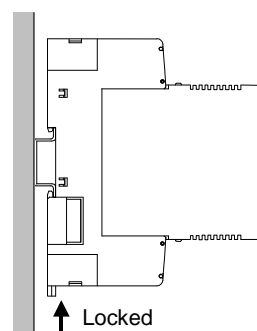

■ End Plate mounting


Hold tight both ends of the modules joined together with the end plates and then fix the end plates with screws. Even if only one X-TIO-R module is used, also hold tight both ends of the module with the end plates.

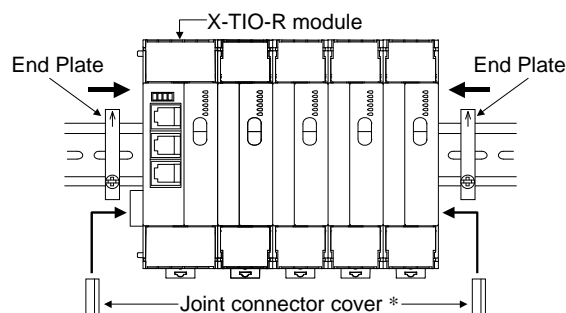

* For the conservation of the contact of connector, install a joint connector cover in module of both ends.

■ Removing procedures

Pull down a mounting bracket with a slotted screwdriver (A). Lift the module from bottom, and take it off (B).

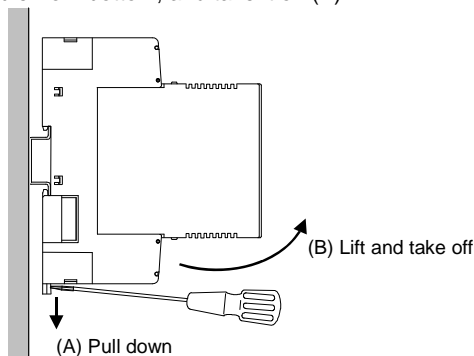

5.4 Panel Mounting



■ Mounting procedures

1. Pull down the mounting bracket (A) until locked and that a mounting hole appears.
2. Prepare one mounting bracket per module (B) sold separately (KSRX-55) and then insert it in the rear of the terminal board at top of the module until locked but a mounting hole does not disappear.
3. Mount each module directly on the panel with screws which are inserted in the mounting holes of the top and bottom mounting brackets.

Recommended tightening torque: 0.3 N·m (3 kgf·cm)



The customer needs to provide the M3 size screws. Select the screw length that matches the mounting panel.

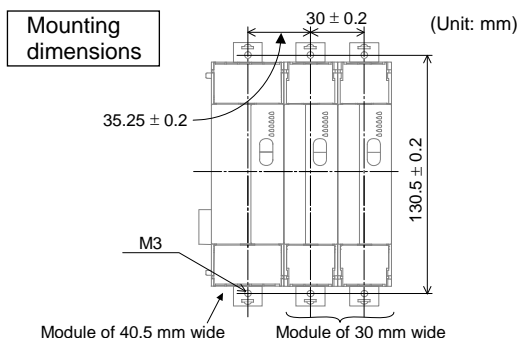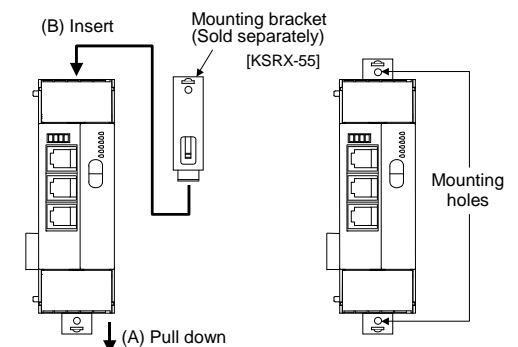


5.5 Jointing Each Module

Up to 29 modules (X-TIO-A/B, X-DI-A/B or X-DO-A/B) can be connected to one X-TIO-R module. Joint these modules according to the following procedure.

■ Jointing procedures

1. Mount the modules on the DIN rail and then joint these modules together with the joint connector while sliding the relevant module.
2. Lift each of the joint tabs located at the top and bottom of the module and then insert it in the slot of the adjacent module to fix these two modules.

For panel mounting, first joint each module and then mount it on the panel.

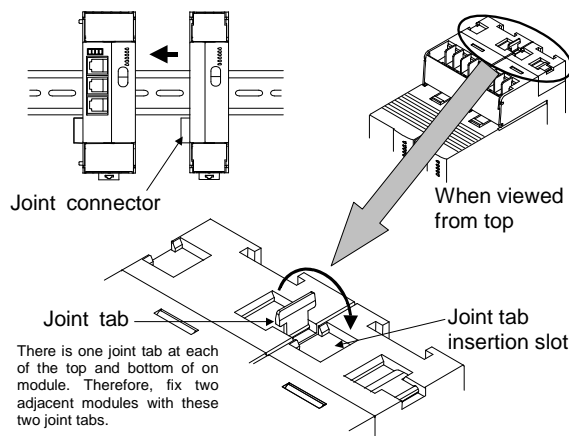

6. WIRING




WARNING

To prevent electric shock or instrument failure, do not turn on the power until all wiring is completed. Make sure that the wiring is correct before applying power to the instrument.


6.1 Wiring Cautions

- For thermocouple input, use the appropriate compensation wire.
- For RTD input, use low resistance lead wire with no difference in resistance between the three lead wires.
- To avoid noise induction, keep input signal wire away from instrument power line, load lines and power lines of other electric equipment.
- Signal connected to Voltage input and Current input shall be low voltage defined as "SELV" circuit per IEC 60950-1.
- If there is electrical noise in the vicinity of the instrument that could affect operation, use a noise filter.
 - Shorten the distance between the twisted power supply wire pitches to achieve the most effective noise reduction.
 - Always install the noise filter on a grounded panel. Minimize the wiring distance between the noise filter output and the instrument power supply terminals to achieve the most effective noise reduction.
 - Do not connect fuses or switches to the noise filter output wiring as this will reduce the effectiveness of the noise filter.

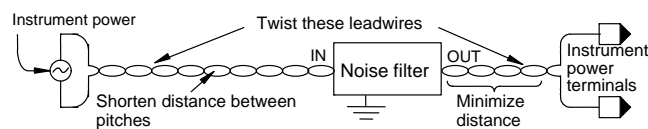


- Power supply wiring must be twisted and have a low voltage drop.
- For an instrument with 24 V power supply input, supply power from "SELV" circuit defined as IEC 60950-1.
- A suitable power supply should be considered in the end-use equipment. The power supply must be in compliance with a limited-energy circuits (maximum available current of 8 A).
- In the maximum configuration (extension up to 30 modules) the 24 V DC supplied equipment may draw up to 4 A. The power supply shall be capable of delivering at least 4 A.

- Use the solderless terminal appropriate to the screw size.
 - Screw size: M3 x 6
 - Recommended tightening torque: 0.4 N·m [4 kgf·cm]
 - Specified solderless terminals: With isolation



- Make sure that during field wiring parts of conductors can not come into contact with adjacent conductive parts.

6.2 Terminal Configuration

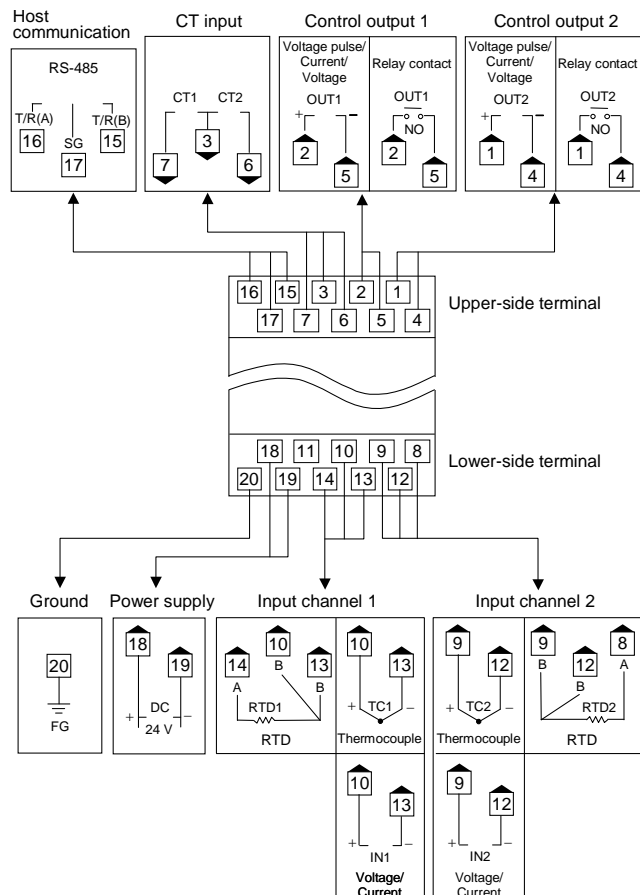


Heater break alarm (HBA) function cannot be used when control output is Voltage/Current output.



- Terminal No. 11 is not used.
- Input channel 2 can be used as remote setting input (only for Voltage/Current input). In this case, control output 2 and CT input 2 become unused.

6.3 Pin Layout of Connector

■ Modular connector

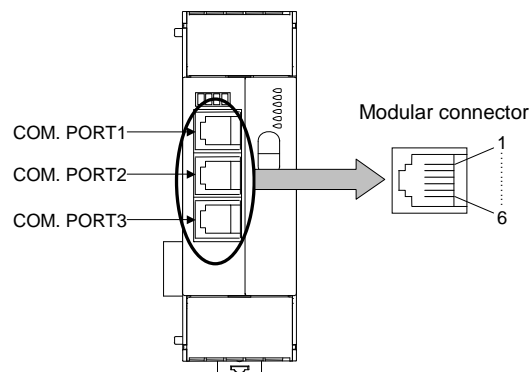

Modular connector COM. PORT1:

Connector for PLC or Host computer connection
Based on RS-422A/RS-232C (Specify when ordering)

Modular connector COM. PORT2:

Connector for PLC or Host computer connection
Based on RS-422A

Modular connector COM. PORT3:

Connector for SRX unit extension
Based on RS-422A

* RS-422A

Pin No.	Signal name	Symbol
1	Receive data	R (A)
2	Receive data	R (B)
3	Signal ground	SG
4	Send data	T (B)
5	Send data	T (A)
6	Signal ground	SG

* RS-232C

Pin No.	Signal name	Symbol
1	Unused	—
2	Send data	SD (TXD)
3	Signal ground	SG
4	Receive data	RD (RXD)
5	Unused	—
6	Signal ground	SG



Customer is requested to prepare a communication cable fit for the X-TIO-R module to be connected by the host computer or PLC.

Connection cable W-BF-01*, W-BF-02 * and W-BF-28 (RKC product) can use to connect the host computer or PLC.

* Shields of the cable are connected to SG (No. 6 pin) of the X-TIO-R connector.



The 6-pin type modular connector should be used for the connection to the X-TIO-R module.

Recommended model:

TM4P-66P

(Manufactured by HIROSE ELECTRIC CO., LTD.)

7. SPECIFICATIONS

■ Inputs

Number of inputs:	2 points (Isolated between each channel)
Input type:	
• Thermocouple:	K, J, T, S, R, E, B, N (JIS-C1602-1995) PLII (NBS) W5Re/W26Re (ASTM-E988-96)
• RTD:	Pt100 (JIS-C1604-1997) JPt100 (JIS-C1604-1989, Pt100 of JIS-C1604-1981)
• Voltage (low):	0 to 10 mV DC, 0 to 100 mV DC, 0 to 1 V DC
• Voltage (high):	0 to 5 V DC, 0 to 10 V DC, 1 to 5 V DC
• Current:	0 to 20 mA DC, 4 to 20 mA DC (Input impedance: 250 Ω)
Sampling cycle:	25 ms
PV bias:	-Input span to +Input span
CT input:	2 points 0.0 to 30.0 A (CTL-6P-N) or 0.0 to 100.0 A (CTL-12-S56-10L-N)

■ Outputs

Number of outputs:	2 points (Isolated between input and output, and between output and power supply)
Output type:	
• Relay contact:	250 V AC, 3 A (Resistive load) 1a contact Electrical life: 300,000 times or more (Rated load)
• Voltage pulse:	0/12 V DC (Load resistance 600 Ω or more)
• Current:	0 to 20 mA DC, 4 to 20 mA DC (Load resistance 600 Ω or less)
• Voltage:	0 to 5 V DC, 0 to 10 V DC, 1 to 5 V DC (Load resistance 1 k Ω or more)

■ Control action

Number of controls:	2 points
Control method:	Brilliant PID control Reverse action or direct action is selectable
Additional function:	Autotuning function Output limiter function Output change rate limiter function

■ Events

Number of events:	2 points/channel
Event type:	Temperature event: Deviation high, Deviation low, Deviation high/low, Band, Process high, Process low

■ Heater break alarm (HBA) function

Number of HBA:	2 points
Setting range:	0.0 to 100.0 A (0.0 A: OFF)
Additional function:	Number of event delay times: 1 to 255 times

■ Control loop break alarm (LBA) function

Number of LBA:	2 points
LBA time:	1 to 7200 seconds
LBA deadband (LBD) setting:	0 to Input span

■ Program control

Number of patterns:	16 patterns max. (With pattern link function)
Number of segments:	16 segments/pattern max.
Time signal output:	16 points/pattern

■ PLC communication

Communication interface:	Based on RS-422A, EIA standard Based on RS-232C, EIA standard (RS-232C: COM. PORT1 only)
Communication protocol:	MITSUBISHI MELSEC series special protocol - ACPU common command (WR/WW) (A series, FX2N, FX2NC series) - AnA/AnUCPU common command (QR/QW) (AnA/QnA series, Q series)
Maximum connections:	Four X-TIO-R modules per communication port of PLC

■ Host communication

● Using host communication terminals

Communication interface:	Based on RS-485, EIA standard
Communication protocol:	RKC communication (ANSI X3.28-1976 subcategories 2.5 and B1) or Modbus
Maximum connections:	31 instruments maximum including a host computer

● Using modular connectors

Communication interface:	Based on RS-422A, EIA standard Based on RS-232C, EIA standard (RS-232C: COM. PORT1 only)
Communication protocol:	RKC communication (ANSI X3.28-1976 subcategories 2.5 and B1) or Modbus
Maximum connections:	RS-422A: 16 X-TIO-R modules RS-232C: 1 X-TIO-R module

■ Others

Power supply voltage:	21.6 to 26.4 V DC (Including power supply voltage variation) Rating: 24 V DC
Current consumption:	185 mA max./module
Allowable ambient temperature:	-10 to +50 $^{\circ}$ C
Allowable ambient humidity:	5 to 95 %RH (Non condensing) Absolute humidity: MAX.W.C 29.3 g/m ³ dry air at 101.3 kPa
Installation environment conditions:	Indoor use Altitude up to 2000 m
Weight:	Approx. 280 g

- Modbus is a registered trademark of Schneider Electric.
- The name of each programmable controller (PLC) means the products of each manufacturer.
- Company names and product names used in this manual are the trademarks or registered trademarks of the respective companies.

The first edition: MAR. 2004 [IMQ00]
The second edition: AUG. 2013 [IMQ00]