

CONTROLLER

Temperature/Process
Controller

FB100



☐ Reinforced Insulation



RKC INSTRUMENT INC.

High Performance 1/16 DIN size Controller

A 1/16 DIN unit (48x48mm) has been added to the FB series high performance and highly reliable controllers.

High performance control is achieved in a small installation space.

* Some functions on FB100 may be limited compared to FB900/400



Reinforced Insulation



(Actual size)

Temperature/Process
Controller

FB100

High Performance
Controller

● High performance

High accuracy : 0.1%

Selectable sampling time:

50msec (Fast response) /100ms (Standard) /250msec (High resolution)

* When the sampling time is set to 0.1 seconds or 0.05 seconds, the following input ranges cannot be used :

Pt100/JPt100 -100.00 to +100.00°C, -199.99 to +199.99°F

Brilliant II PID Control

• Selectable PID control algorithm

PV Derivative PID: suitable for fixed setpoint control (Factory setting)


Deviation derivative PID: suitable for ramp control using ramp-to-setpoint function and cascade control

• Ramp-to-setpoint/Output change rate limiter

• Advanced Heat/Cool PID algorithm with Undershoot Suppression

● Easy maintenance

The internal assembly of the FB100 can be removed from the front.

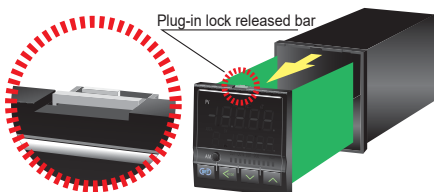

● Panel space saving: 74mm depth

The FB100 has very short depth as a 1/16 DIN size controller. The FB100 was designed with a mounting bracket that allows close horizontal mounting of as many as six units.



● Numerous inputs and outputs

Universal input
Thermocouple • RTD
DC voltage • DC current

Up to 5 points

Digital input

Remote setting input

Up to 2 points

CT input

Up to 2 points
Communication

Up to 3 points
Digital output

Analog retransmission
output

Heat control

Cool control

Heat/Cool control

Position proportioning
control without FBR

ANSI, MODBUS communication

Inter-controller communication

Data monitoring/logging tool

Loader communication

User-friendly Keys and Display

One-touch Operation on
Mode Selection, Memory
Area Selection and Monitor

AUTO/MAN
LOC/REM
RUN/STOP
Memory area select
Monitor

Easy-to-read
5 Digit LED Display

Elastomer key tops



Bar Graph display
(10 LED segments)

• Control output value
• Setting value (SV)
• Measured value (MV)
• CT1/CT2 input
• Deviation between
SV and PV

Reinforced Insulation

Reinforced insulation retains its insulating ability even when basic insulation breaks down. The power circuits in our instruments are designed with reinforced insulation and will save costs by eliminating the need for additional safety measures to prevent break-down shock.

<Requirements for electrical equipment according to safety standards>

The safety standards on electrical equipment (JISC 1010-1 and IEC 61010-1) require that the secondary side of the equipment which may be touched by the operator should be double insulated or reinforcement insulated* from high voltage that would result in electric shock.

* Insulation safeguarding personnel from electric shock which is equal to double insulation or higher is called "reinforced insulation".



Inter-controller Communication

Inter-controller communication achieves more precise cascade control and ratio control by sending data via digital communication while conventional cascade controllers send data to slave controllers by analog signal with less resolution.

Auto-temperature-rise with Learning Function

Auto-temperature-rise with learning function achieves temperature uniformity at ramp-up without partial thermal expansion even when using multiple FB100 controllers.


- Up to 32 controllers with 16 groups can be configured.
- Auto-temperature-rise function is not available with position proportional PID control type.

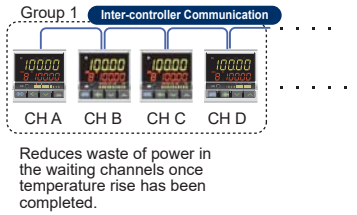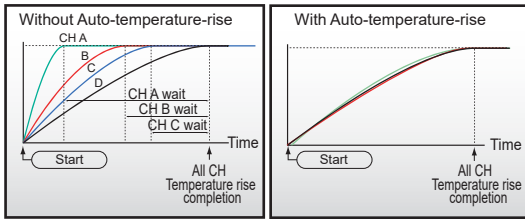

Temperature Ratio Setting


If the master controller changes the control set value, the slave controllers will also change the set values by following preset ratios to the master.

- Up to 32 controllers with 16 groups can be configured.

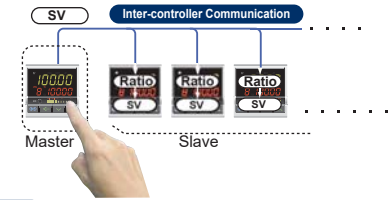

Cascade Control


It is effective when a thermal time-delay exists between the heat source and a control point. A maximum of 31 slave controllers can be connected to one master controller.



Group RUN/STOP Function

When RUN/STOP mode is changed on one controller in a group, the mode of all the other controllers in the same group will be also automatically changed.


- Up to 32 controllers with 16 groups can be configured.

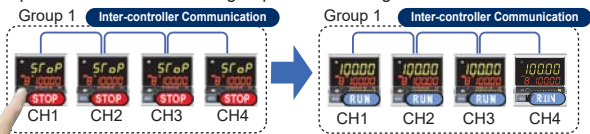

(Note) Time lag among controllers caused by inter-controller communication is Max.70ms x number of controllers connected.
Please consider the time lag of inter-controller communication for high-speed process control in which process changes rapidly.


Recipe (Multi-memory Area) Function

The FB100 has Multi-memory Area function which stores up to 8 sets of control parameters. Parameters in a memory area can be changed at one time by selecting the memory area number through key operation, DI, or communication.

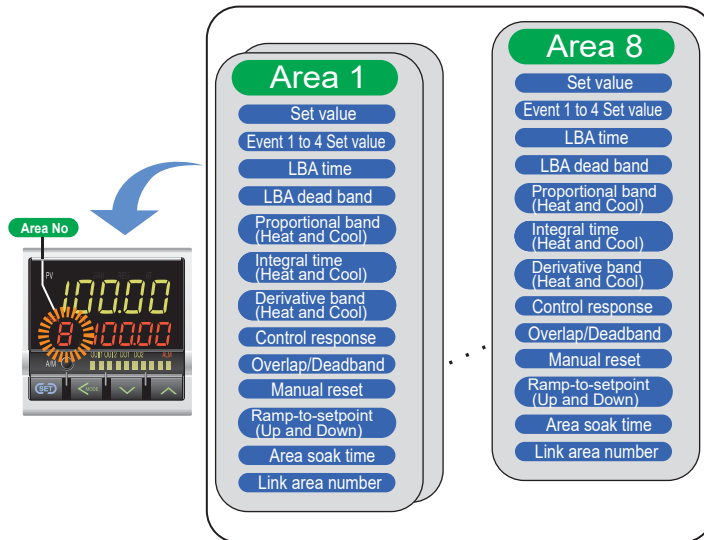


Ramp/Soak Program Control

Up to 16-segment ramp/soak control is available by using the Memory Area function: area soak time, link area number, ramp-to-setpoint Up and Down.

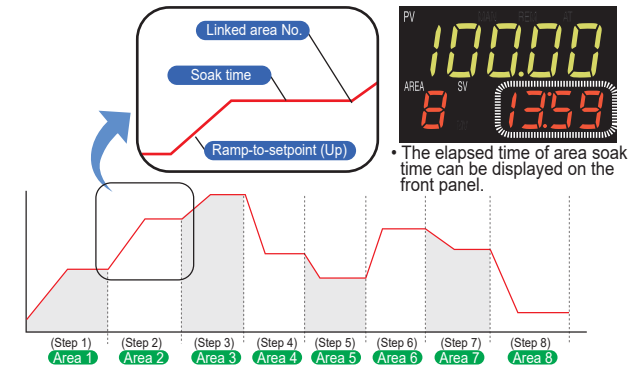

Start-up tuning to eliminate time for autotuning

Start-up tuning eliminates time required for conventional autotuning as it calculates optimum PID values by temperature characteristics at start up. It is useful in applications which require a long time for conventional autotuning. The timing of activation of start-up tuning can be selected from at power-up, at setpoint change, and at power-up/setpoint change. It is also settable to Only-once or always-ON.

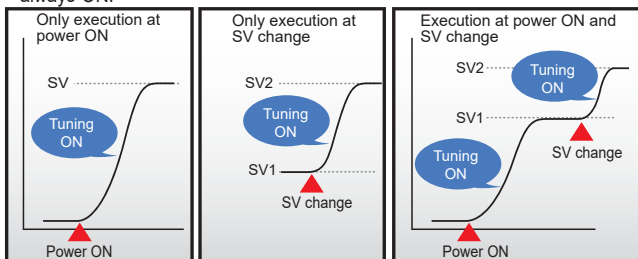


Reduces power consumption during AT execution

- Start-up tuning function can be set ON/OFF.
- Heater power needs to be turned on simultaneously with or before turning on power to the temperature controller.
- Start-up tuning (ST) is when the temperature differential of the measured value (PV) and set value (SV) is at least twice the proportional band at the start of start-up tuning (ST).
- If start-up tuning does not calculate suitable PID values due to characteristics of application, use Autotuning function.
- Start-up tuning function is not available with position proportional PID control type.

Easy parameter setup via USB loader port

The FB series has a standard loader port to connect to a PC USB port via COM-KG: USB communication converter. Using the PROTEM2, the controller setup and parameter settings can be done from a PC. The parameter settings can be stored on the PC making it easy to copy the same parameters to other FB100 controllers. Simply download "PROTEM2" from the RKC Instrument website

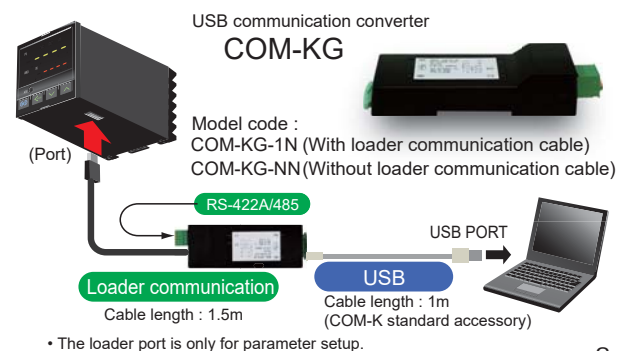

Specifications

Input

Input	<ul style="list-style-type: none"> • Universal input a) Temperature, Current, Low voltage input group <ul style="list-style-type: none"> Thermocouple : K, J, E, T, R, S, B, N (JIS/IEC) PLII (NBS), W5Re/W26Re (ASTM) U, L (DIN) RTD : Pt100 (JIS/IEC), JPt100 (JIS) • 3-wire system Low voltage (Input impedance : More than 1MΩ) <ul style="list-style-type: none"> 0 to 1V DC, 0 to 100mV, 0 to 10mV DC -100 to +100mV DC, -10 to +10mV DC Current (Input impedance : 50Ω) <ul style="list-style-type: none"> 4 to 20mA, 0 to 20mA b) High voltage input group <ul style="list-style-type: none"> High voltage (Input impedance : 1MΩ) <ul style="list-style-type: none"> -1 to +1V DC, 0 to 5V DC, 1 to 5V DC, 0 to 10V DC (Use dip switch to change input group.)
Sampling time	0.1sec <ul style="list-style-type: none"> • 0.05sec/0.25sec is selectable. • When the sampling time is set to 0.1 sec or 0.05 sec, the following input ranges cannot be used: Pt100 / JPt100 -100.00 to +100.00 $^{\circ}$ C, -199.99 to +199.99 $^{\circ}$ F
Influence of external resistance	0.2mV/ Ω (Thermocouple input)
Influence of lead resistance	0.01% of reading/ Ω (RTD input) <ul style="list-style-type: none"> • Maximum 10Ω per wire
Input break action	Thermocouple input : Up-scale/Down-scale (Selectable) RTD input : Up-scale Low voltage input : Up-scale/Down-scale (Selectable) Current input : Value around 0mA High voltage input : Value around 0V
Input short action	Down-scale (RTD input)
Input digital filter	0.1 to 100.0 sec. (OFF when 0 is set.)
PV bias	-span to +span
PV ratio	0.500 to 1.500
Square root extraction	PV = $\sqrt{\text{Input value} \times \text{PV ratio} + \text{PV bias}}$ Low level cut off : 0.00 to 25.00% of span

Control

Control method	a) Brilliant II PID control <ul style="list-style-type: none"> • Direct action/Reverse action is selectable b) Brilliant II PID control (Heat/Cool type) c) Position proportioning control without feedback resistance <ul style="list-style-type: none"> • Direct action/Reverse action is selectable • a), b), c) is selectable
Autotuning	a) For PID control (Direct action/Reverse action) b) For Heat/Cool PID control (For extruder, air cooling) c) For heat/Cool PID control (For extruder, water cooling) d) For heat/Cool PID control (Direct action/Reverse action) The condition to activate Startup Tuning is selectable among a) to g).
Startup tuning	a) At power-on, one-time tuning b) At SV change, one-time tuning c) At power-on and SV change, one-time tuning d) At power-on, always on e) At SV change, always on f) At power-on and SV change, always on g) Function off (Not available for Heat/Cool PID control type)
Setting range	a) Proportional band : <ul style="list-style-type: none"> Temperature input : 0 to input span ($^{\circ}$C, $^{\circ}$F) Voltage/Current input : 0.0 to 1000.0% of input span (ON/OFF control when P = 0) • Differential gap at ON/OFF control (High/Low individual setting) : Temperature input : 0 to input span ($^{\circ}$C, $^{\circ}$F) Voltage/Current input : 0.0 to 10.0% of input span b) Integral time : 0 to 3600 sec or 0.0 to 1999.9 sec (selectable) (PD control when I = 0) c) Derivative time : 0 to 3600 sec or 0.0 to 1999.9 sec (selectable) (PI control when D = 0) d) Cool side proportional band : <ul style="list-style-type: none"> Temperature input : 0(0.0, 0.00) to input span ($^{\circ}$C, $^{\circ}$F) Voltage/Current input : 0.0 to 1000.0% of input span e) Cool side Integral time : <ul style="list-style-type: none"> 0 to 3600 sec or 0.0 to 1999.9 sec (selectable) (PD control when I = 0) f) Cool side Derivative time : <ul style="list-style-type: none"> 0 to 3600 sec or 0.0 to 1999.9 sec (selectable) (PI control when I = 0) g) Overlap/Deadband <ul style="list-style-type: none"> Temperature input : -span to +span ($^{\circ}$C, $^{\circ}$F) Voltage/Current input : -100.0 to +100.0% of input span h) Control response : Slow, Medium, Fast i) Ramp-to-setpoint <ul style="list-style-type: none"> 0 to span per Time (Time is settable between 1 and 3600 sec) Up/Down individual setting j) Output limiter : -5.0 to +105.0% (High/Low individual setting) k) Output change rate limiter : 0.0 to 100.0%/sec (Up/Down individual setting) l) Proportional cycle time : 0.1 to 100.0 sec m) Cool side proportional cycle time : 0.1 to 100.0 sec n) Manual reset : -100.0 to +100.0% o) Output at Control Stop mode : -5.0 to +105.0% (Heat side/Cool side individual setting)

Position Proportional Control

Motor time	5 to 1000 sec
Integral output limiter	OFF, 0.1 to 200.0% of motor time
Neutral zone	0.1 to 10.0%
Differential gap	0.1 to 5.0%
Output at Control Stop mode	Selectable from the following : a) Close : Output off, Open : Output off b) Close : Output on, Open : Output off c) Close : Output off, Open : Output on

Performance

Measuring accuracy	a) Thermocouple <ul style="list-style-type: none"> Type : K, J, T, E, PLII, U, L Less than -100$^{\circ}$C (-148$^{\circ}$F) : $\pm 1.0^{\circ}$C ($\pm 1.8^{\circ}$F) -100 to +500$^{\circ}$C (-148 to 932$^{\circ}$F) : $\pm 0.5^{\circ}$C ($\pm 0.9^{\circ}$F) More than 500$^{\circ}$C (932$^{\circ}$F) : $\pm 0.1\%$ of reading + 1 digit Type : N, S, R, W5Re/W26Re Less than 0$^{\circ}$C (32$^{\circ}$F) : $\pm 2.0^{\circ}$C ($\pm 3.6^{\circ}$F) 0 to 1000$^{\circ}$C (32 to 1832$^{\circ}$F) : $\pm 1.0^{\circ}$C ($\pm 1.8^{\circ}$F) More than 1000$^{\circ}$C (1832$^{\circ}$F) : $\pm 0.1\%$ of reading + 1 digit Type B Less than 400$^{\circ}$C (752$^{\circ}$F) : $\pm 70.0^{\circ}$C ($\pm 126^{\circ}$F) 400 to 1000$^{\circ}$C (752 to 1832$^{\circ}$F) : $\pm 1.4^{\circ}$C ($\pm 2.5^{\circ}$F) More than 1000$^{\circ}$C (1832$^{\circ}$F) : $\pm 0.1\%$ of reading + 1 digit • Cold junction temperature compensation error $\pm 1.0^{\circ}$C (1.8$^{\circ}$F) [Between 5 and 40$^{\circ}$C (41 and 104$^{\circ}$F)] $\pm 1.5^{\circ}$C (2.7$^{\circ}$F) [Between -10 and 5$^{\circ}$C (16 and 41$^{\circ}$F), and 40 and 50$^{\circ}$C (104 and 122$^{\circ}$F)] b) RTD <ul style="list-style-type: none"> Less than 200$^{\circ}$C (392$^{\circ}$F) : $\pm 0.2^{\circ}$C ($\pm 0.4^{\circ}$F) More than 200$^{\circ}$C (392$^{\circ}$F) : $\pm 0.1\%$ of reading + 1 digit c) DC voltage and DC current <ul style="list-style-type: none"> $\pm 0.1\%$ of span)
Close horizontal mounting error	$\pm 1.5^{\circ}$ C (2.7 $^{\circ}$ F)
Insulation resistance	More than 20M Ω (500V DC) between measured terminals and ground More than 20M Ω (500V DC) between power terminals and ground More than 20M Ω (500V DC) between measured and power terminals
Dielectric voltage	1500V AC for one minute between measured terminals and ground 1500V AC for one minute between power terminals and ground 2300V AC for one minute between measured and power terminals

Output

Number of outputs	Up to 2 points (OUT1, OUT2)
Output function	Control output, HBA output, FAIL output • See output allocation table (page 7)
Output signal	a) Relay contact output, Form a contact 250V AC 3A (Resistive load) • Electric life : 300,000 cycles or more b) Voltage pulse output, 0/12V DC (Load resistance : More than 600 Ω) c) Current output, 4 to 20mA DC, 0 to 20mA DC (Load resistance : Less than 600 Ω) d) Continuous voltage output, 0 to 5V DC, 1 to 5V DC, 0 to 10V DC (Load resistance : More than 1k Ω) e) SSR (Triac) output, Rated current : 0.5A f) Open collector output (Sink type) Load voltage : Less than 30V DC Load current : Less than 100mA ON voltage : Less than 2V (at maximum load current)

Digital Output(DO)

(Standard)

Number of inputs	Up to 2 points (OUT1, OUT2)
Output function	Event output, Heater break alarm (HBA), FAIL
Output signal	Relay contact output, Form a contact 250V AC 1A (Resistive load)

Multi-Memory Area(recipe)

Number of areas	8 areas (recipes)
Stored parameters	a) Set value (SV) b) Event set values 1 to 4 c) LBA time d) LBA dead band e) Proportional band f) Integral time g) Derivative time h) Cool side proportional band i) Cool side integral time j) Cool side derivative time k) Overlap/Deadband l) Manual reset m) Control response parameter n) Ramp-to-setpoint (Up/Down) o) Soak time <ul style="list-style-type: none"> 0 min 00 sec to 199 min 59 sec or 0 hr 0 min to 99 hr 59 min (selectable) p) Linking area number : OFF, 1 to 8

Specifications

Event (Alarm)

(Standard)

Number of events	Up to 4 points
Event type	Process high, Process low, Deviation high, Deviation low Deviation high/low, Band, Set value high, Set value low, MV value high, MV value low, Cool side MV value high, Cool side MV value low, FBR value high, FBR value low, LBA (Control loop break alarm) • LBA is assignable to event 4.
Setting range	a) Deviation alarm Event set value : -input span to +input span Event action differential gap : 0 to input span b) Process alarm/Set value alarm Event set value : Same as input range Event action differential gap : 0 to input span c) MV alarm, FBR alarm -5.0 to +105.0% d) LBA LBA time : 0 to 7200 sec (LBA is OFF when 0 is set.) Dead band : 0 to input span
Output terminals	Assignable to digital output (DO 1 to 2) or Output 2 (OUT2) • See output allocation table (page 7)
Other functions	a) Hold/Re-hold action (Valid for deviation/band/process alarm only) • Hold action is activated at Power-up and STOP to RUN. Re-hold action is activated at Power-up, STOP to RUN and the control set value change. b) Event action is configurable in case of input abnormality. c) Energized/de-energized action is configurable. d) Delay timer : 0.0 to 600.0 sec e) Interlock (latch) function is configurable.

Heater Break Alarm (HBA)

(Optional)

Number of alarms	2 points (1 point per CT input)
CT Type and input range	CTL-6-P-N : 0 to 30A CTL-12-S56-10L-N : 0 to 100A
Display range	0.0 to 100.0A
Display accuracy	±(5% of input value + 1 digit) or 2A (whichever is larger)
Output terminals	Assignable to output 2 or digital output (DO 1 to 2) • See output allocation table (page 7)

Digital Input (DI)

(Optional)

Number of inputs	Up to 5 points (DI 1 to 5)
Input method	Non-voltage contact input
Function	Memory area selection (Area set/No area set is selectable) RUN/STOP, Remote/Local, Auto/Manual, Alarm interlock reset • Selectable • See digital input allocation table (page 7)

Remote Setpoint Input

(Optional)

Input	a) Low voltage group 0 to 1V DC, 0 to 100mV DC, 0 to 10mV DC b) High voltage group 0 to 5V DC, 1 to 5V DC, 0 to 10V DC c) Current group 4 to 20mA DC, 0 to 20mA DC • Universal input • Not isolated from measured input
Sampling time	0.1 sec (with measuring input sampling time of 0.05 sec) 0.2 sec (with measuring input sampling time of 0.1 sec) 0.5 sec (with measuring input sampling time of 0.25 sec)
Accuracy	±0.1% of span

Analog Retransmission Output (AO)

(Optional)

Number of outputs	1 point
Output type	Measured value (PV), Set value (SV) Manipulated value (MV), Deviation (between PV and SV) • Selectable
Output signal	4 to 20mA DC, 0 to 20mA DC (Load resistance : Less than 600 Ω) 0 to 1V DC, 0 to 5V DC, 1 to 5V DC, 0 to 10V DC (Load resistance : More than 1k Ω)
Resolution	Approx. 1/4000
Output accuracy	±0.1% of span

Feedback Resistance (FBR) Input

(Optional)

Resistance value	Standard : 100 to 10k Ω (factory default 135 Ω)
Sampling time	0.1 sec (with measuring input sampling time of 0.05 sec) 0.2 sec (with measuring input sampling time of 0.1 sec) 0.5 sec (with measuring input sampling time of 0.25 sec)

Communications

(Optional)

Communication method	COM1 : RS-485
Communication speed	2400bps, 4800bps, 9600bps, 19200bps, 38400bps
Protocol	a) ANSI X3.28 sub-category 2.5A4 (RKC standard) b) MODBUS-RTU
Bit format	a) RKC standard protocol Start bit : 1 Data bit : 7 or 8 Parity bit : 1 (odd or even) or none Stop bit : 1 or 2 b) MODBUS protocol Start bit : 1 Data bit : 8 (binary or byte data) Parity bit : 1 (odd or even) or none Stop bit : 1 or 2
Maximum connection	32 units (Including host)

Inter-controller Communication

(Optional)

Function : Auto-temperature-rise, Cascade control,
Temperature ratio setting, Group STOP/RUN

Loader communication

Protocol	ANSI X3.28 sub-category 2.5A4 (RKC standard)
Communication speed	38400bps
Bit format	Start bit : 1, Data bit : 8, Parity bit : none, Stop bit : 1
Maximum connection	1 unit (Address : 0)

Waterproof/Dustproof

(Standard)

NEMA4X, IP66
• Waterproof/Dustproof protection only effective from the front in panel mounted installation.

General Specifications

Supply voltage	a) 90 to 264V AC (50/60Hz, Selectable) Rating : 100 to 240V AC b) 24V AC ±10% (50/60Hz, Selectable) Rating : 24V AC c) 24V DC ±10% Rating : 24V DC
Power consumption	a) 100 to 240V AC type 5.4VA (240V), 8.1VA (100V) b) 24V AC type 5.3VA c) 24V DC type 142mA
Rush current	Less than 12A
Power failure	A power failure of 20m sec or less will not affect the control action. If power failure of more than 20m sec occurs, controller will restart with the state of HOT start 1, HOT start 2 or COLD start (selectable)
Memory backup	Backed up by non-volatile memory (FRAM) • Data retaining period : Approx. 10 years • Number of writing : Approx. 1,000,000,000,000,000 times. (Depending on storage and operating conditions.)
Ambient temperature	-10 to +50°C (14 to 122°F)
Ambient humidity	5 to 95% RH (Non condensing) • Absolute humidity : MAX.W.C 29g/m ³ dry air at 101.3kPa
Weight	Approx. 150g
Operating environment	Free from corrosive and flammable gas and dust. Free from external noise, vibration, shock and exposure to direct sunlight.
Compliance with Standards	CE Mark, UL, C-UL, C-Tick mark

Model and Suffix Code

Specifications		Model and Suffix Code									
		(48 x 48mm 1/16 DIN size)	Hardware coding only						Quick start code 1		/Y
		FB100 -	①	②	③	④	⑤	⑥	⑦	⑧	
①	Output 1 (OUT 1)	Relay contact output	M								
		Voltage pulse output (0/12V DC)	V								
		DC mA, V See Output Code Table									
		Triac output	T								
		Open collector output	D								
②	Output 2 (OUT 2)	Not supplied	N								
		Relay contact output	M								
		Voltage pulse output (0/12V DC)	V								
		DC mA, V See Output Code Table									
		Triac output	T								
③	Power Supply	24V AC/DC		3							
		100 to 240V AC		4							
④	Optional function	Not supplied			N						
		Digital input 5 points			A						
		Digital input 2 points + Remote setpoint input			B						
		Digital input 2 points + Feedback resistance input			C						
		Digital input 2 points + CT input 2 points			D						
		Digital input 3 points + Communication 1 point			E						
		Digital input 1 point + Communication 1 point + CT input 1 point			F						
		Communication 2 points			G						
		Communication 1 point + CT input 2 points			H						
		Digital input 1 point + Remote setpoint input + Analog retransmission output 0 to 1V DC			3						
		Digital input 1 point + Remote setpoint input + Analog retransmission output 0 to 5V DC			4						
		Digital input 1 point + Remote setpoint input + Analog retransmission output 0 to 10V DC			5						
		Digital input 1 point + Remote setpoint input + Analog retransmission output 1 to 5V DC			6						
		Digital input 1 point + Remote setpoint input + Analog retransmission output 0 to 20mA			7						
		Digital input 1 point + Remote setpoint input + Analog retransmission output 4 to 20mA			8						
⑤	Case color	White case			N						
		Black case			A						
⑥	Quick start code	No quick start code (Default setting)						N			
		Specify quick start code 1						1			
		Specify quick start code 1 and 2 (See page 11)						2			
⑦	Control Method	No quick start code							No Code		
		PID control with AT (Reverse action) ♦						F			
		PID control with AT (Direct action)						D			
		Heat/Cool PID control with AT						G			
		Heat/Cool PID control with AT for extruder (Air cooling type)						A			
		Heat/Cool PID control with AT for extruder (Water cooling type)						W			
		Position proportional PID control without FBR						Z			
⑧	Input and range	No quick start code							No Code		
		See Input range Code Table									
⑨	Instrument version	Version symbol									/Y

♦ Default setting

• Digital output (DO1, DO2) : Standard function

*1 : When Heat Control or Cool Control is selected, output 2 is available for Event Output, HBA Output and FAIL Output.
See Output Allocation Table (page 7).

*2 : See Digital Input (DI) Allocation Table (page 7).

*3 : When HBA (heater break alarm) is used, select the "CT input" from the model code.

Output Code Table

Output Type	Code	Output Type	Code
0 to 5V DC	4	0 to 20mA DC	7
0 to 10V DC	5	4 to 20mA DC	8
1 to 5V DC	6		

Input Range Code Table

Thermocouple

Input	Code	Range	Input	Code	Range
K	K : 35	-200.0 to +400.0°C	J	J : C7	-200.0 to +700.0°F
	K : 40	-200.0 to +800.0°C		J : C6	-328.0 to +1200.0°F
	K : 09	0.0 to 400.0°C		J : B6	0.0 to 800.0°F
	K : 10	0.0 to 800.0°C		J : B9	-328 to +2192°F
	K : 41 ♦	-200 to +1372°C		J : A1	0 to 800°F
	K : 02	0 to 400°C		J : A2	0 to 1600°F
	K : 04	0 to 800°C	T	T : 19	-200.0 to +400.0°C
	K : C6	-250.0 to +800.0°F		T : C2	-328.0 to +752.0°F
	K : C4	-328.0 to +400.0°F		S : 06	-50 to +1768°C
	K : A4	0.0 to 800.0°F		S : A7	-58 to +3214°F
	K : C5	-328 to +2502°F	R	R : 07	-50 to +1768°C
	K : A1	0 to 800°F		R : A7	-58 to +3214°F
	K : A2	0 to 1600°F	E	E : 21	-200.0 to +700.0°C
	J : 27	-200.0 to +400.0°C		E : 06	-200 to +1000°C
J	J : 32	-200.0 to +800.0°C		E : A9	-328.0 to +1292.0°F
	J : 08	0.0 to 400.0°C		E : B1	-328 to +1832°F
	J : 09	0.0 to 800.0°C	B	B : 03	0 to 1800°C
	J : 15	-200 to +1200°C		B : B2	0 to 3272°F
	J : 02	0 to 400°C	N	N : 02	0 to 1300°C
	J : 04	0 to 800°C		N : A7	0 to 2372°F

♦ Default setting

RTD

Input	Code	Range	Input	Code	Range
Pt100	D : 34	-100.00 to +100.00°C *1	JPt100	P : 29	-100.00 to +100.00°C *1
	D : 35	-200.0 to +850.0°C		P : 30	-200.0 to +640.0°C
	D : 21	-200.0 to +200.0°C		P : C8	-199.99 to +199.99°F *1
	D : C8	-199.99 to +199.99°F *1		P : C9	-328.0 to +1184.0°F
	D : C9	-328.0 to +1562.0°F		P : D1	-200.0 to +200.0°F
	D : D1	-200.0 to +200.0°F			
PLII (NBS)	A : 02	0 to 1390°C	WRe/W26Re (ASTM)	W : A2	0 to 4200°F
	A : A2	0 to 2534°F		W : 03	0 to 2300°C
	U : 04	0.0 to 600.0°C		U : B2	32.0 to 1112.0°F
	(DIN) U : B4	32.0 to 1112.0°F		L : 04	0.0 to 900.0°C
	L : 04	0.0 to 900.0°C		L : A9	32.0 to 1652.0°F
	(DIN) L : A9	32.0 to 1652.0°F			

DC Current • voltage


Input	Code	Range	Input	Code	Range
0 to 10mV	1 : 01	0.0 to 100.0%	0 to 20mA ^{*1}	7 : 01	0.0 to 100.0%
0 to 100mV	2 : 01		4 to 20mA ^{*1}	8 : 01	
0 to 1V	3 : 01		-100 to +100mV	9 : 01	
0 to 5V	4 : 01		-1 to +1V	9 : 02	
0 to 10V	5 : 01		-10 to 10mV	9 : 03	
1 to 5V	6 : 01				

*1 If you wish to use the 1/100°C(°F) input range, please set the sampling time to 0.25 seconds.

*1 : Shunt resistor is not required for current input.

Accessories (Sold separately)

● Current transformer for heater break alarm (HBA)

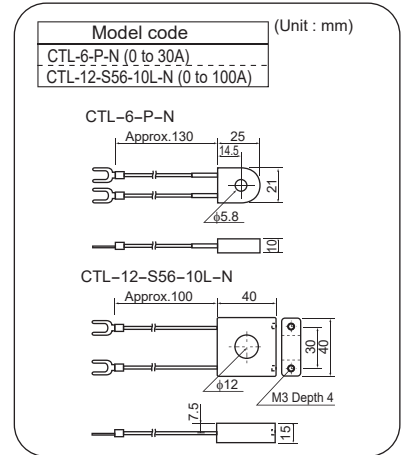

● Terminal Cover



Model Code :
KCA100-517

● Front Cover



Model Code :
KRB100-36A

Quick start code

- Quick start code tells the factory to ship with each parameter preset to the values detailed as specified by the customer. Quick start code is not necessarily specified when ordering, unless the preset is requested. These parameters are software selectable items and can be re-programmed in the field via the manual.

Specifications	Quick start code	①	②	③	④	⑤	⑥	⑦	⑧	⑨
① Output allocation	(See output allocation table)									
② Digital input allocation	(See Digital input allocation table)									
③ Remote setpoint input signal	No Remote setpoint input signal									
	0 to 10mV DC									
	0 to 100mV DC									
	0 to 1V DC									
	0 to 5V DC									
	0 to 10V DC									
	1 to 5V DC									
	0 to 20mA DC									
	4 to 20mA DC									
④ Event 1 type	No event 1 (See event type code table)									
⑤ Event 2 type	No event 2 (See event type code table)									
⑥ Event 3 type	No event 3 (See event type code table)									
⑦ Event 4 type	No event 4 (See event type code table)									
⑧ CT type	No CT1 and CT2									
	CT1 : CTL-6-P-N, CT2 : No use									
	CT1 : CTL-12-S56-10L-N, CT2 : No use									
	CT1 : CTL-6-P-N, CT2 : CTL-6-P-N									
	CT1 : CTL-12-S56-10L-N, CT2 : CTL-12-S56-10L-N									
⑨ Communication 1	No communication 1 (COM1)									
	ANSI/RKC standard protocol									
	MODBUS protocol									
	Inter-controller protocol									

Event Code Table

(Programmable)

Code	Event type
A	Deviation High
B	Deviation Low
C	Deviation High/Low
D	Band
E	Deviation High with Alarm Hold
F	Deviation Low with Alarm Hold
G	Deviation High/Low with Alarm Hold
H	Process High
J	Process Low
K	Process High with Alarm Hold
L	Process Low with Alarm Hold
Q	Deviation High with Alarm Re-Hold
R	Deviation Low with Alarm Re-Hold
T	Deviation High/Low with Alarm Re-Hold
V	Set value High
W	Set value Low
1	MV value High
2	MV value Low
3	Cool side MV value High
4	Cool side MV value Low

- Default setting when no quick start code is specified.
CT type : CTL-6-P-N
Communication 2 : ANSI/RKC standard protocol
- Communication 2 is for inter-controller communication.

Output Allocation Table

◆ Default setting

Code	Output 1 (OUT 1)	Output 2 (OUT 2)	Digital Output 1 (DO 1)	Digital Output 2 (DO 2)
01 ◆	Control output 1	Control output 2	Event 1	Event 2
02	Control output 1	Control output 2	Event 1	Event 4
03	Control output 1	Control output 2	Event 1	HBA
04	Control output 1	Control output 2	Event 1	FAIL (De-energized)
05	Control output 1	Control output 2	Event 4	HBA
06	Control output 1	Control output 2	Event 4	FAIL (De-energized)
07	Control output 1	Control output 2	HBA	FAIL (De-energized)
08	Control output 1	HBA	Event 1	Event 2
09	Control output 1	HBA	Event 1	Event 4
10	Control output 1	HBA	Event 1	FAIL (De-energized)
11	Control output 1	HBA	Event 4	FAIL (De-energized)
12	Control output 1	FAIL (De-energized)	Event 1	Event 2
13	Control output 1	FAIL (De-energized)	Event 1	Event 4
14	Control output 1	Event 1	Event 2	Event 3
15	Control output 1	Event 4	Event 1	Event 2

- Energized/De-energized is configurable except for the FAIL output.
(Factory default setting: Energized)

(Caution)

- Invalid for a non-existing output/input function.
- When used as heating/cooling control/position proportioning control, select any code of 01 to 07.
- Remote/Local transfer can be done during cascade control and ratio control by inter-controller communication.

Digital input (DI) Allocation Table

◆ Default setting

Code	DI 1	DI 2	DI 3	DI 4	DI 5	Selectable optional Code
01 ◆	Unused					—
02	Memory area selection (1 to 8)	Area set	RUN/STOP	—	—	A
03	Memory area selection (1 to 8)	Area set	—	—	—	
04	Memory area selection (1 to 8)	Area set	AUTO/MANUAL	—	—	
05	Memory area selection (1 to 8)	Area set	Alarm interlock reset	—	—	
06	Memory area selection (1 to 8)	RUN/STOP	—	—	—	
07	Memory area selection (1 to 8)	RUN/STOP	AUTO/MANUAL	—	—	
08	Memory area selection (1 to 8)	RUN/STOP	Alarm interlock reset	—	—	
09	Memory area selection (1 to 8)	—	AUTO/MANUAL	—	—	A, E
10	Memory area selection (1 to 8)	—	Alarm interlock reset	—	—	
11	Memory area selection (1 to 8)	AUTO/MANUAL	Alarm interlock reset	—	—	
12	Memory area selection (1 to 8)	—	—	—	—	
13	RUN/STOP	REMOTE/LOCAL	AUTO/MANUAL	—	—	A, B, C, D, E
14	RUN/STOP	REMOTE/LOCAL	Alarm interlock reset	—	—	
15	RUN/STOP	AUTO/MANUAL	Alarm interlock reset	—	—	
16	REMOTE/LOCAL	AUTO/MANUAL	Alarm interlock reset	—	—	
17	RUN/STOP	REMOTE/LOCAL	—	—	—	
18	RUN/STOP	AUTO/MANUAL	—	—	—	
19	RUN/STOP	Alarm interlock reset	—	—	—	
20	REMOTE/LOCAL	AUTO/MANUAL	—	—	—	A, B, C, D, E, F 3, 4, 5, 6, 7, 8
21	REMOTE/LOCAL	Alarm interlock reset	—	—	—	
22	AUTO/MANUAL	Alarm interlock reset	—	—	—	
23	RUN/STOP	—	—	—	—	
24	REMOTE/LOCAL	—	—	—	—	
25	AUTO/MANUAL	—	—	—	—	
26	Alarm interlock reset	—	—	—	—	

Example of Model Code and Quick start code

Specifications

Input : Thermocouple K 0.0 to 400.0°C
Control method : PID control for heating (Output : 4 to 20mA DC)
Digital Output (Alarm) : 2 points (Deviation High, Deviation Low)
Analog retransmission output : 0 to 10V DC
Digital input : 1 point (RUN/STOP)

Model code

FB100-8N-□*5/□-2FK09

Output 1 (Heat output) : 4 - 20mA DC
Output 2 (Cool output) : None
Optional function : Digital input : 1 point
Remote setpoint input : 1 point
Analog retransmission output 0 to 10V DC
Quick start code : Specify quick start code 1 and 2
Control Method : PID control with AT (Reverse action)
Input and range : K 0.0 to 400.0°C


Quick start code

0123-□ABNN-NN


Output Allocation : OUT1: Control output 1, OUT2: Control output 2
DO1: Event 1, DO2: Event 2
* OUT2 : Unused
* Digital output (DO1, DO2) : Standard function
Digital Input Allocation : DI1: RUN/STOP
Event 1 : Deviation High
Event 2 : Deviation Low
Event 3 : None
Event 4 : None
CT type : None
Communication 1 protocol : None

External Dimensions


Unit : mm

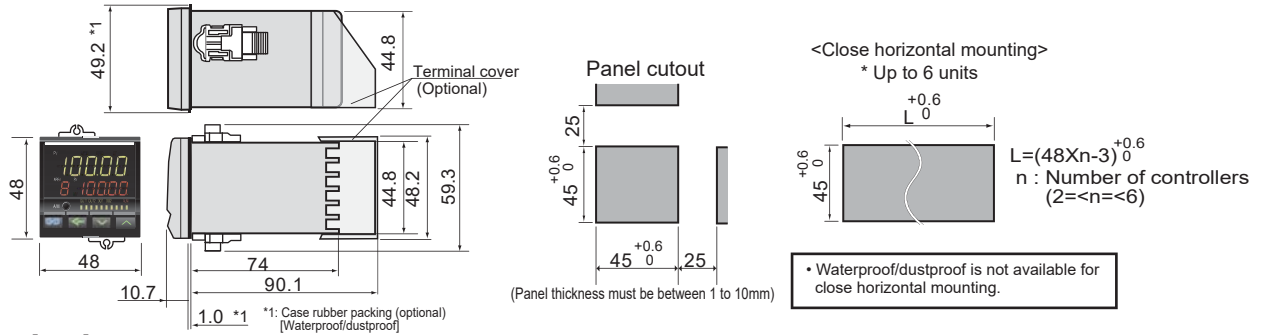

Rear Terminals

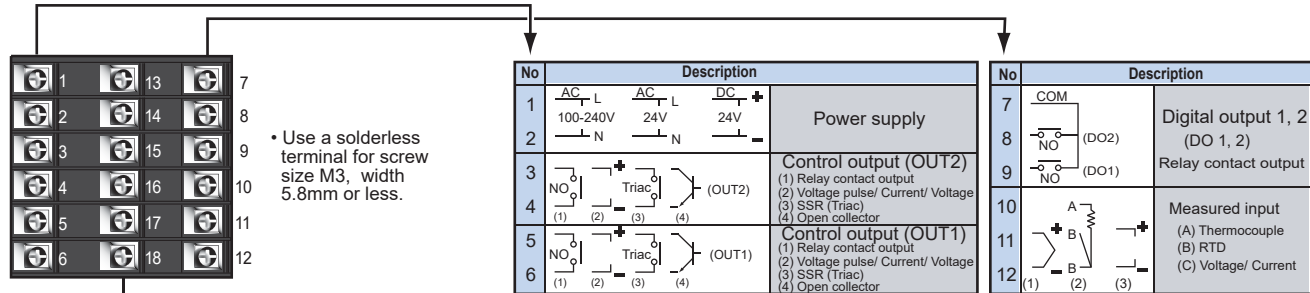

Optional function terminals

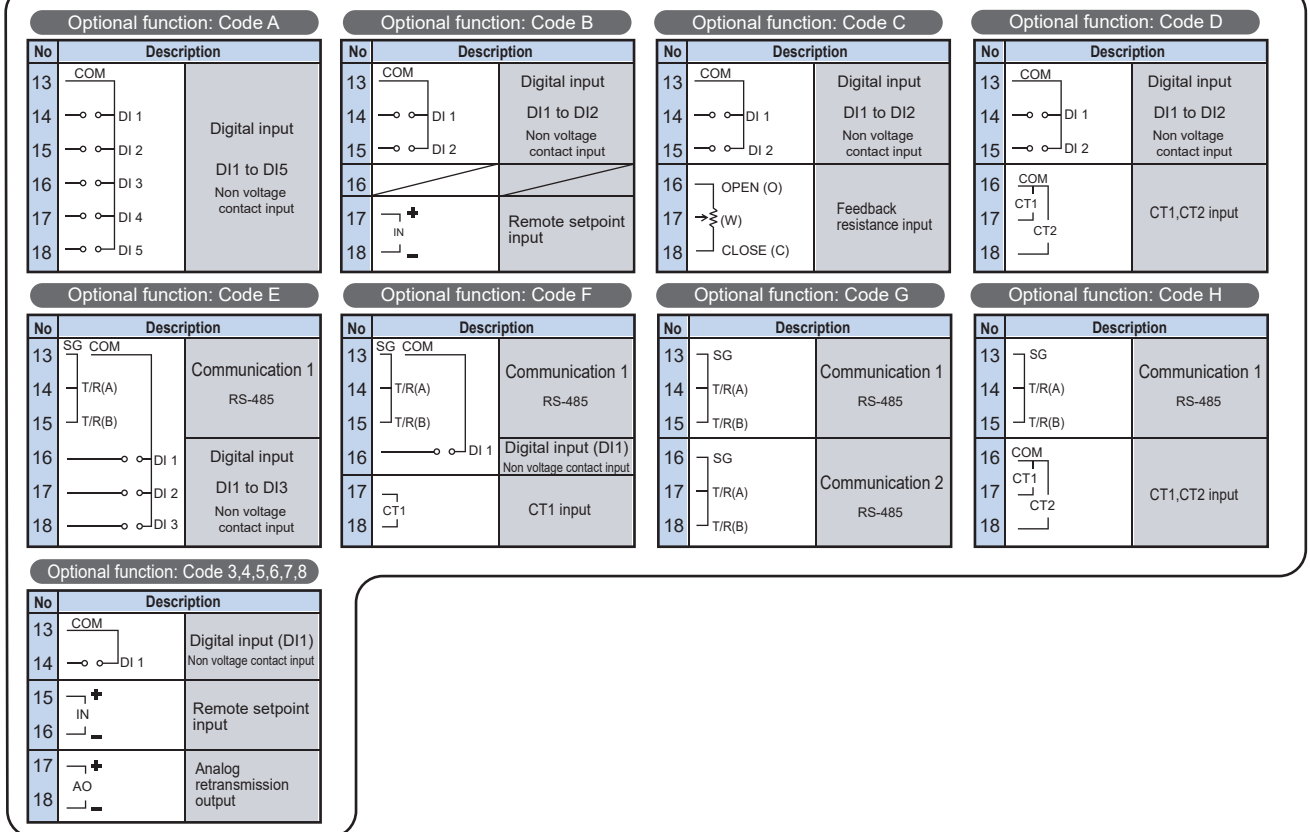

- Before operating this product, read the instruction manual carefully to avoid incorrect operation.
- This product is intended for use with industrial machines, test and measuring equipment. It is not designed for use with medical equipment.
- If it is possible that an accident may occur as a result of the failure of the product or some other abnormality, an appropriate independent protection device must be installed.

Caution for the export trade

All transactions must comply with laws, regulations, and treaties.

Caution for imitated products

As products imitating our product now appear on the market, be careful that you don't purchase these imitated products. We will not warrant such products nor bear the responsibility for any damage and/or accident caused by their use.

RKC **RKC INSTRUMENT INC.**
(RIKA KOGYO CO.,LTD)

HEAD OFFICE : 16-6, KUGAHARA 5 CHOME OHTA-KU TOKYO 146-8515 JAPAN
PHONE : 03-3751-9799 (+81 3 3751 9799)
Email : info@rkcinst.co.jp
FAX : 03-3751-8585 (+81 3 3751 8585)
https://www.rkcinst.com/